



Seismic qualified

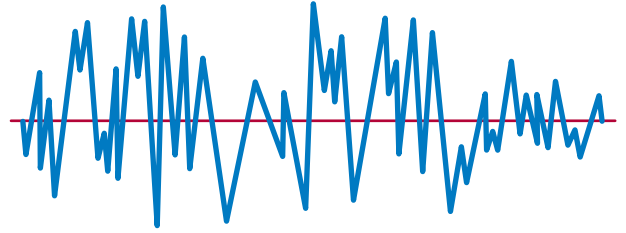

Caterpillar Paralleling Switchgear utilizing Eaton Corporation's equipment identified below was tested for seismic withstand capability and tested in accordance with the combined requirements specified in the International Building Code, the California Building Code, and the Uniform Building Code.

As required by the codes, the equipment demonstrated its ability to function after the seismic tests. The seismic capability of the equipment exceeds the worst-case required levels, as illustrated in the figure below.

Metal-Enclosed Low Voltage Paralleling Switchgear and Deadfront Switchboards with Magnum™ DS, SB or Series NRX Breakers Equipped with Caterpillar Generator Control Systems Based on PLC Automation or EMCP3.S Controller Technology

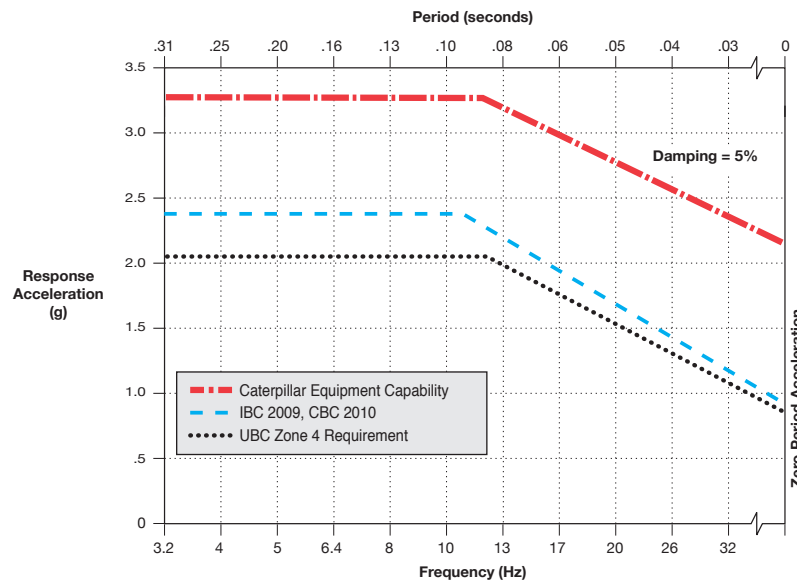

The frequency sweep tests revealed that the lowest equipment natural frequency is:

6.2 Hz

Drawing Number
SA01900008E

Nathan Glenn, PE
Westinghouse Electric Company, LLC

3RD PARTY TEST ENGINEER IN CHARGE

TESTED BY
Wyle Laboratories
September 2008 – 55906R08-5B
August 2010 – EQLR-157F

For interpretation of testing data,
refer to Eaton
Publication SA12501SE

Eaton Corporation
Electrical Sector
1111 Superior Ave.
Cleveland, OH 44114
United States
877-ETN-CARE (877-386-2273)
Eaton.com

© 2011 Eaton Corporation
All Rights Reserved
Printed in USA
August 2011

Eaton is a registered trademark
of Eaton Corporation.

All other trademarks are property
of their respective owners.