

Low-voltage power distribution and control systems > Automatic transfer switches >

Contactor type transfer switches

Contents

General Description	25.1-2
Product Configuration	25.1-2
Design Highlights	25.1-2
Standard Features	25.1-2
Assembly Ratings	25.1-3
Enclosure Structure	25.1-6
NEMA Enclosure Types	25.1-6
Power Bus	25.1-6
Power Connections	25.1-6
Cable Ingress and Access	25.1-7
Devices	25.1-8
Power Switch	25.1-8
ATC-900 Automatic Controller	25.1-12
ATC-300+ Automatic Controller	25.1-16
HMi Remote Annunciator Controller	25.1-17
Communication	25.1-17
Advanced Metering	25.1-18
Surge Protection	25.1-18
Control Power Transformer	25.1-18
Thermographic Imaging	25.1-18
Synchroscope	25.1-19
Protective Relays	25.1-19
Layouts and Dimensions	25.1-20
Standard Layouts	25.1-20
Standard Dimensions and Weights	25.1-21
Application Data	25.1-24
Usual Environmental Conditions	25.1-24
Unusual Environmental Conditions	25.1-24
Heat Loss	25.1-24
Application Fundamentals	25.1-25
Transfer Switches	25.1-25
UL 1008 Standard	25.1-32
NFPA 70 System Installation Types	25.1-34





Automatic Transfer Switch (ATS)



**Bypass Isolation ATS
(with enhanced serviceability)**

General Description

Eaton's contactor type transfer switches are constructed with a robust electrically controlled, double-throw power switch for quickly and reliably transitioning critical loads between preferred and alternate power sources.

Designs are intended for use in emergency (NEC® 700), legally required (NEC 701), optional standby (NEC 702), and critical operation power systems (NEC 708) to include special occupancies such as healthcare facilities (NEC 517).

Standard and custom configurations are available.

Product Configuration

- ATS and bypass isolation ATS
- Automatic and non-automatic operation
- Open and closed transition
- 2-, 3- and 4-pole
- 40–3000 A
- Single- and three-phase
- Up to 600 Vac, 3- or 4-wire
- 50/60 Hz
- NEMA® 1, 3R, 3RX, 4X, 12 and open frame
- Drawout or fixed mounting
- Service entrance rated

Design Highlights

- Automatic transfer control
- UL® 1008 and CSA® Listed
- Short-circuit and short-time withstand closing current ratings
- Electrical and manual operation
- Spring stored energy mechanism
- Quick make / quick break
- Manual transfer under load
- Multi-tap control power transformer
- Switched or solid neutral (fully rated)
- Electrical and mechanical interlocks
- Tethered remote control
- Top/bottom cable entry
- Seismic certified
- Wallmount and freestanding enclosure types
- Service entrance design marked for use at 100% of amperage rating and fully UL 1008 Listed
 - Integral overcurrent protection with electronic trip (LSI, LSIG, ALSI, ALSIG)
 - ARMS (Arcflash Reduction Maintenance System™) complies with NEC 240.87
- Bypass isolation ATS with enhanced serviceability
 - Automatic bypass switch
 - Dual drawout (ATS and bypass)
 - 3-door compartmentalized construction
 - Maintenance isolation switch
 - Isolate/Test automatic transfer switch
 - Isolate/Test automatic bypass switch

Standard Features (ATS)

- ATC-900 controller (ATC-300+, ATC-100 configurations available)
- Color liquid crystal display (LCD)
- Keypad navigation
- Mimic bus with LED indication
 - Source available
 - Source connected
 - Preferred source
- Source sensing
 - Undervoltage/overvoltage
 - Underfrequency/overfrequency
 - Phase sequence
 - Voltage unbalance/phase loss
 - Negative sequence detection
- Load sensing
 - Residual voltage decay
- Dual automatic plant exercisers
 - Load/no load engine test
 - Daily, 7-, 14-, 28-day
 - Calendar date
 - Engine runtime
- Programmable time delays
 - Engine start
 - Normal to emergency
 - Emergency to normal
 - Engine cool-down
 - Emergency engine fail
 - Pre-/post-transfer
 - Source disconnect/reconnect
 - Load disconnect
 - Source synchronization
- Source available relay outputs
- Auxiliary position contacts
- Engine start contacts (Form C)
- Programmable I/O
 - Control inputs (multipurpose)
 - Relay outputs (multipurpose)
- System diagnostics and help
- Serial communication (Modbus®)
- USB port
 - Power quality data and setpoint download/upload
 - Firmware field update
- Password protection
- Silver-plated bus
- Mechanical lug terminals

Optional Features (ATS)

- Dedicated operator control (selector switch/pushbutton)
- Load metering (integral to controller)
 - Current
 - Power (kW, kVA, kvar)
 - Power factor
- Temperature-controlled heater element
- Surge protection device (up to 400 kA)
- Advanced power quality metering
- Ethernet communication
- Programmable I/O (up to 20 control inputs and 20 relay outputs)
- 24 Vdc or 120 Vac controller supply power provision
- HMI remote annunciator controller
- Lift device and yoke
- Tin-plated bus
- Bus duct termination
- IR scan window
- Enclosure
 - Front access cabinet
 - Depth extension
 - Filters and gaskets
 - Custom paint colors
 - Stainless steel
- Protective relays
- Synchroscope
- Compression lug terminals
- Source cable termination swap (top/bottom)
- Tethered remote control for non-automatic operation outside of arc flash boundary

Standard Features (Bypass Isolation ATS with Enhanced Serviceability)

- Automatic operation of bypass switch and ATS provide operational redundancy
- Dual drawout design allows ATS and bypass switch to be withdrawn or isolated for test without interrupting power to the load
- Three-door compartmentalized design provides protective steel barriers between workers and energized components
- Maintenance isolation switch (MIS) permits service personnel to electrically isolate the control compartment and mitigate shock hazard, without downtime for critical loads
- Control compartment door and adjoining electrical panel slide forward from the enclosure to provide easy access to wiring and components
- Integral safety interlocks automatically open main contacts prior to the ATS or bypass switch being withdrawn and isolated for test
- Nonautomatic and manual operation of ATS and bypass switch
- Shutters ^① automatically close when the ATS or bypass switch is being racked out, providing bus isolation

Optional Features (Bypass Isolation ATS with Enhanced Serviceability)

- All the optional features of a conventional ATS

Assembly Ratings

- Continuous current (amperes): 40, 80, 100, 150, 200, 225, 260, 400, 600, 800, 1000, 1200, 1600, 2000, 2500, 3000
- System voltage (ac): 120, 208, 220, 240, 380, 415, 480, 600
- Operating frequency (Hz): 50, 60
- UL 1008 withstand closing current (when protected by fuse): 200 kA short circuit ^① (600 V)
- UL 1008 withstand closing current (when protected by circuit breaker):
 - 100 kA short circuit ^① (0.05 sec/600 V)
 - 85 kA short time ^① (0.5 sec/600 V)
- Certifications:
 - UL 1008 Listed
 - CSA 22.2, No. 178 Listed
 - Seismic—OSHDP, IBC, CBC, UBC zone 4
 - NEMA 1, 3R, 4X, 12

^① Applicable for select product configurations.

Table 25.1-1. UL 1008 Withstand and Closing Current Ratings (Contactor-Type ATS)

Transfer Switch Rating (A)	Device Type	Short-Circuit Withstand Closing Current Rating (kA)										Short-Time Withstand Closing Current Rating (kA)	
		When Protected by a Circuit Breaker		When Protected by a Specific Circuit Breaker		When Protected by a Specific Fuse						When Protected by a Circuit Breaker	
		Time Duration (0.05 sec. ①② Max.)		Manufacturing and Type Based		Manufacturing and Type Based						Time Duration (0.05 sec. Max.)	
		480 Vac Max. (kA)	600 Vac Max. (kA)	480 Vac Max. (kA)	600 Vac Max. (kA)	480 Vac Max. (kA)	Fuse Class	Max. Fuse Size (A)	600 Vac Max. (kA)	Fuse Class	Max. Fuse Size (A)	480 Vac Max. (kA)	600 Vac Max. (kA)
40 80 100	C2	10	10	100	22	100	K5, RK5	200	100	K5, RK5	200	—	—
							K1, RK1	400		K1, RK1	400	—	—
							J, T	450		J, T	450	—	—
150 200	C2	10	22	100	35	100	K5, RK5	400	200	RK1, RK5, J, C, K1, K5	600	—	—
							J, K1, RK1	600		L	800	—	—
							T	800		T	1200	—	—
225 260 400	C2	30	—	100	—	200	RK1, RK5, J, C, K1, K5	600	200	J, T, L, RK5	600	—	—
							L	800		L	1600	—	—
							T	1200		L	1600	—	—
40 ③ 80 ③ 100 ③ 150 ③ 200 ③	C3 ③, C5	30 ③	22 ③	100 ③	35 ③	200 ③	RK1, RK5, J, C, K1, K5	600	200 ③	RK1, RK5, J, C, K1, K5	600	—	—
							L	800		L	800	—	—
							T	1200		T	1200	—	—
225 260 400	C3, C5	30	50	100	65	200	RK1, RK5, J, C, K1, K5	600	200	J, T, L, RK5	600	—	—
							L	800		L	1600	—	—
							T	1200		L	1600	—	—
600 800	C3, C5	50	50	150	65	200	J, T, L, RK5	600	200	J, T, L, RK5	600	30 ④	—
							L	1600		L	1600	30 ④	—
1000 1200	C3, C5	50	50	65	65	200	J, T, L, RK5	600	200	J, T, L, RK5	600	—	—
							L	1600		L	1600	—	—
1600	C3, C5	50	—	65	—	200	J, T, L, RK5	600	—	—	—	—	—
							L	2000					
1600 2000 2600 3000	F5, G5	100	100	100	100	200	J, T, L, RK5	600	—	—	—	85 ⑤	85 ⑤
							L	2000				85 ⑤	85 ⑤

① For open transition transfer switches rated 40–200 A (C2 device type), time duration is 0.025 sec maximum.

② For closed transition transfer switches rated 40–200 A (C3 device type), time duration is 0.025 sec maximum.

③ For closed transition transfer switches rated 40–100 A (C3 device type) or 150–200 A (C3 device type), the short-circuit withstand closing current ratings associated with a C2 device type apply.

④ Time duration is 0.13 sec. maximum.

⑤ G5 device type only.

Table 25.1-2. UL 1008 Withstand and Closing Current Ratings (Contactor-Type Bypass Isolation ATS)

Transfer Switch Rating (A)	Device Type	Short-Circuit Withstand Closing Current Rating (kA)										Short-Time Withstand Closing Current Rating (kA)	
		When Protected by a Circuit Breaker		When Protected by a Specific Circuit Breaker		When Protected by a Specific Fuse						When Protected by a Circuit Breaker	
		Time Duration (0.05 sec. Max.)		Manufacturing and Type Based		Manufacturing and Type Based						Time Duration (0.05 sec. Max.)	
		480 Vac Max. (kA)	600 Vac Max. (kA)	480 Vac Max. (kA)	600 Vac Max. (kA)	480 Vac Max. (kA)	Fuse Class	Max. Fuse Size (A)	600 Vac Max. (kA)	Fuse Class	Max. Fuse Size (A)	480 Vac Max. (kA)	600 Vac Max. (kA)
100 150 200	C3, C5	30	22	100	35	200	RK1, RK5, J, C, K1, K5	600	200	RK1, RK5, J, C, K1, K5	600	—	—
							L	800		L	800	—	—
							T	1200		T	1200	—	—
225 250 400	C3, C5	30	42	100	65	200	RK1, RK5, J, C, K1, K5	600	200	RK1, RK5, J, C, K1, K5	600	—	—
							L	800		L	1600	—	—
							T	1200		L	1600	—	—
600 800	C3, C5	50	42	150	65	200	J, T, L, RK5	600	200	J, T, L, RK5	600	30 ①	—
							L	1600		L	1600	30 ①	—
1000 1200	C3, C5	50	42	65	65	200	J, T, L, RK5	600	200	J, T, L, RK5	600	—	—
							L	1600		L	1600	—	—
1600	C3, C5	50	—	65	—	200	J, T, L, RK5	600	—	—	—	—	—
							L	2000					
100–3000	F5	100	100	100	100	200	J, T, L, RK5	600	—	—	—	—	—
							L	2000					
100–3000	G5	100	100	100	100	200	J, T, L, RK5	600	—	—	—	85	85
							L	2000				85	85

① Time duration is 0.13 sec. maximum.

Enclosure Structure

Standard Finish

Gray finish (ANSI 61) is applied to interior and exterior surfaces using an automated electrostatic powder coat system that includes spray de-grease and clean, spray rinse, iron phosphate spray coating spray rinse, non-chemical seal, oven drying, electrostatic powder spray paint coating and oven cure.

Frame

A rugged frame, constructed of 12-gauge steel, provides structure rigidity.

Door

The enclosure front door(s), constructed of 12- or 14-gauge steel (dependent on product configuration), is hinged and attached to the enclosure frame. The door is secured using a handle (or latch) with padlock provision. The automatic controller (when configured) and device option panel(s) are mounted within the front door. When the door is open, service personnel have access to the power switches, terminal blocks, control wiring, electrical components and other accessories. Door swing is a minimum of 90 degrees.

Covers

Side and rear bolted covers (where used) are constructed of 14-gauge steel and attached to the enclosure frame. Covers are typically split into upper and lower panels to facilitate ease of handling. Covers can be removed to gain access to cable terminations, wiring, and devices for installation or maintenance.



*Removing the Upper Side Cover,
Lifting Brackets can be Seen at the Top*

Lifting Brackets

Located at the apex of a freestanding enclosure structure, lifting brackets can be extended upward and locked in place for lifting and moving the transfer switch. When not in use, lifting brackets are retracted.

Mounting Points

The transfer switch assembly includes multiple mounting points at the base for anchoring the enclosure to the floor. Product configurations designed for attachment to a vertical surface (wallmount) include mounting points at the enclosure apex and base.

NEMA Enclosure Types

Contactor type transfer switch enclosures are available as NEMA 1, 3R, 12 or 4X.

Standard construction is steel with a gray finish (ANSI 61) applied to all interior and exterior surfaces. Alternatively, 304 or 316 grade stainless steel, with a mill or painted finish, can be provided for corrosive environments. For indoor or outdoor environments, vented enclosure panels can be fitted with replaceable air filters.

Open frame type

For integration or retrofit applications, an open frame transfer switch provides a power switch assembly with mechanical lugs mounted on a robust steel panel. A second steel panel includes a control power transformer, neutral assembly and related system components (relays). An automatic controller is mounted on a small device panel. System wire harnesses are included, and an optional 96-inch wire extension is available when integrating into larger spaces.

Power Bus

Silver-plated bus is provided as the standard configuration for contactor type transfer switches and meets the needs of most installation sites.

For applications with special chemical environments, tin-plated bus can be provided to mitigate against the growth of silver filaments (whiskers).

Hydrogen sulfide is a colorless, poisonous, flammable gas that can often be found in waste water treatment facilities because it results from the bacterial breakdown of organic matter in the absence of oxygen.

When silver is exposed to hydrogen sulfide, whiskers can form which has the potential to create a dangerous situation for electrical equipment. Tin-plated bus can also whisker, but the length is usually shorter (compared to silver) and limited to a few millimeters thus minimizing risk.




Silver Whisker Growth

Power Connections

UL listed screw-type mechanical lug terminals (Cu/Al) are the standard connection method for power cables. Lugs include an anti-rotation feature and are mounted directly on the power bus (source and load). Alternatively, provisions can be provided for connection via two-hole compression lug terminals or direct bus termination.

For applications requiring a busway connection, provisions can be made in the enclosure roof to accept a standard flange (3-wire or 4-wire). For multiple busway connections, one or more side cabinets can be added, and/or the enclosure depth can be increased. A busway flange drawing, with dimensional and orientation information, must be provided to the factory.

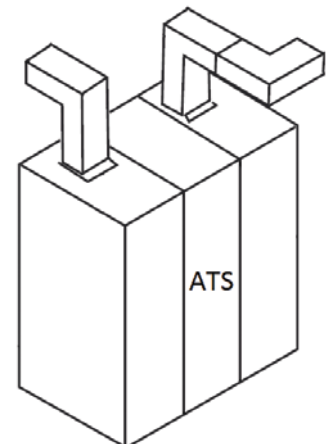

*Busway Flange Termination
at Side Cabinet Roof*

Cable Ingress and Access


Contactor type transfer switches are designed to accommodate cable entry at the top and/or bottom of the enclosure.

For wallmount enclosures, normal power connections are located closer to the top and emergency/load power connections are closer to the bottom.


For freestanding enclosures, normal power connections are closer to the top, emergency power connections closer to the bottom, and load connections are in the center. For installation flexibility a “source swap” option is available that reverses the location of the normal and emergency connections. Removable panels provide access to cable termination points. To accommodate unique installation requirements, a freestanding enclosure can be extended in depth and/or a side cabinet added.

Bypass isolation contactor type ATSs are only available in a freestanding enclosure. Normal, emergency, and load connections can be configured for a variety of cable entry (top/bottom) configurations.

Cable connection locations are arranged at the factory for bypass isolation ATS designs with a fixed automatic bypass switch. For designs with a drawout automatic bypass switch, cable connection locations are arranged at the factory but can also be adjusted in the field via configurable bus.

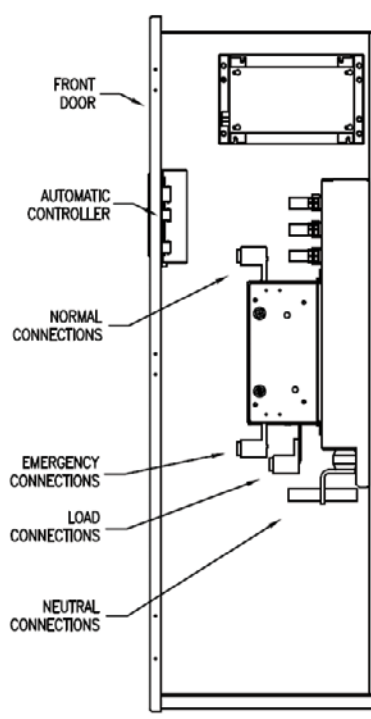


ATS—NEMA 1 wallmount enclosure
(right side view)

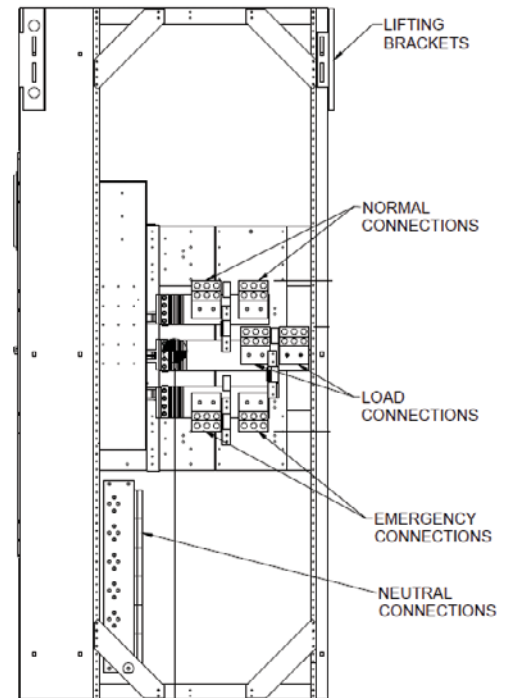


ATS—NEMA 1 freestanding enclosure
(right side view)



Bypass isolation ATS—close-up
of configurable bus

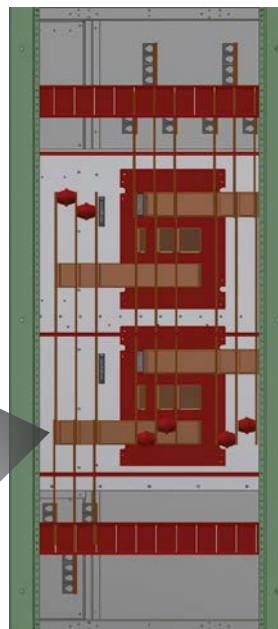

Bypass isolation ATS—configurable bus
allows cable connection locations
(top/bottom) to be field modified.

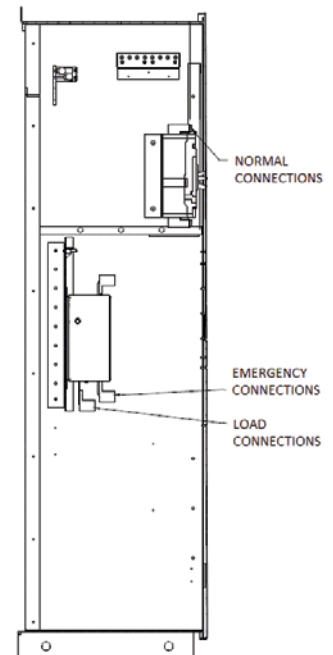

Service Entrance ATS—NEMA 1
freestanding enclosure (left side view)

Power Switch

At the heart of a contactor type transfer switch is Eaton's electrically controlled, double-throw power switch specifically designed and intended for switching a load connection between two power sources. A power switch assembly consists of an electrical operator and multiple power poles (2, 3 or 4).

Power Pole

Each power pole includes a pair of main contacts (silver composition) that are electrically operated and mechanically held in place. The main contacts are electrically and mechanically interlocked to prevent unintentional paralleling of the two power sources. Colored flags provide mechanical position indication of the main contacts (source 1 and source 2).


A complete movable main contact assembly is a combination of a number of single contact fingers. The exact number of contact fingers required depends upon the frame size of the power switch. Braided conductors (flexible shunts) are used to attach each contact finger to the power bus. The result is an efficient and uniquely functional main contact system.

Rigid Frame Housing


Power poles are encased (and isolated from each other) in a rigid frame housing constructed of durable high-strength material with excellent dielectric characteristics able to withstand high-dynamic and thermal stresses.

Arc Chutes


Removable arc chutes are mounted within arc chambers over each set of main contacts. The arc chambers act to channel arc gases up and out through the arc chutes. The arc chutes are constructed of metal plates and a baffle cover designed to extinguish an electrical arc and protect the main contacts. Removal of an arc chute from the arc chamber allows for visual inspection of the main contacts.

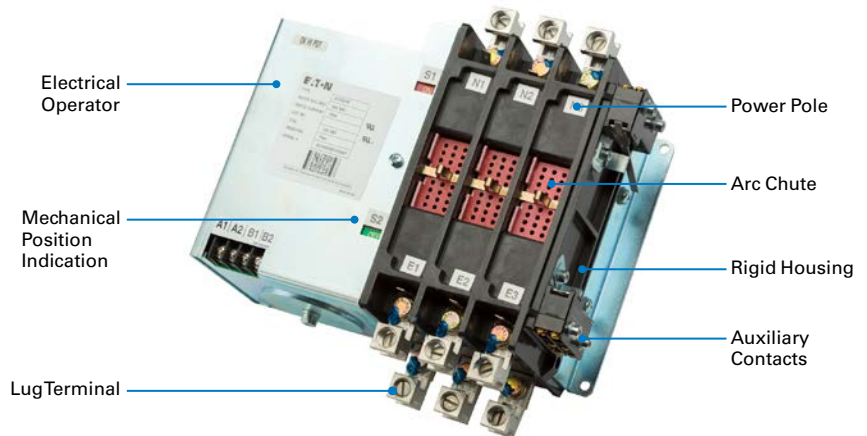

Power Switch Assembly, Fixed
(100 A frame, front view)

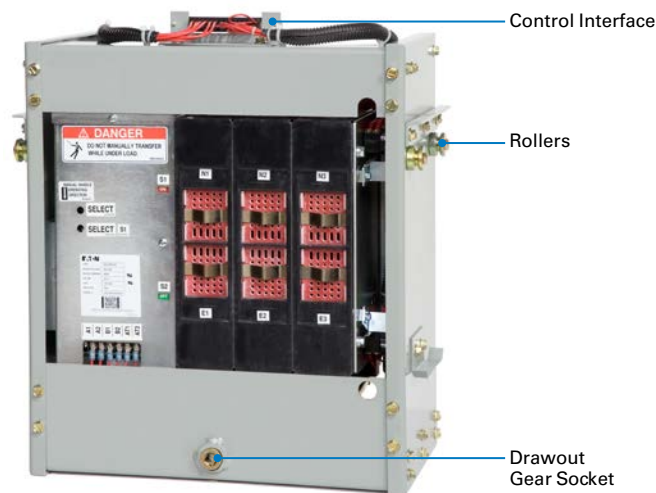

Power Switch Assembly, Drawout
(400 A frame, front view)

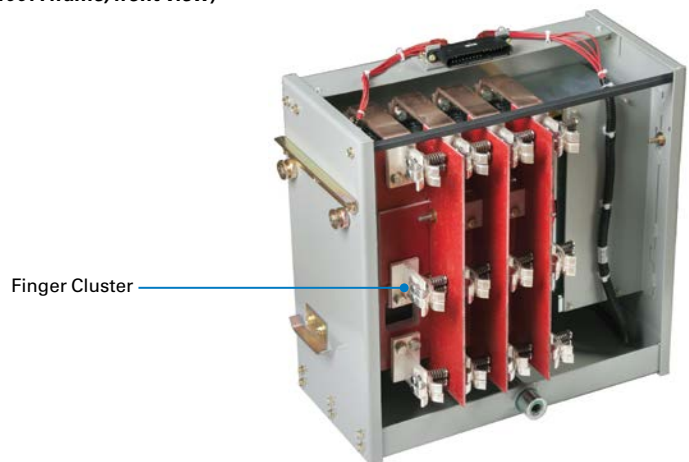

Power Switch Assembly, Drawout
(400 A frame, rear view)

Electrical Operator

Power switches have an electrically operated solenoid mechanism that momentarily energizes to close or open the main contacts. For automatic transfer switches, the operator is controlled by microprocessor controller logic. For non-automatic transfer switches, the electrical operator is typically controlled via a local or remote switch panel.

Control power for electrical operation is derived from the power source to which the load is being transferred.

For product configurations with a power switch frame size of 1600 A or less, the transfer switch can be manually operated (no load) via a handle. In contrast, configurations constructed with a power switch frame size of 3000 A are equipped with a spring stored energy mechanism and can be manually operated (with load or without) via pushbutton control. The spring stored energy mechanism is charged electrically via motor (or manually via handle as a redundant backup). When charged, a complete transfer and re-transfer sequence can be performed.

A Kirk key option is available with the 3000 A frame size to lock out the power switch. When locked out, the main contacts remain open and the load connection is disconnected.


Device Type

Power switch assemblies include a device type designation. A two-position device type (C2) is capable of connecting the load to either power source (normal or emergency). A three-position device type (C3, C5, F5, G5) is capable of connecting the load to either power source (normal or emergency) or disconnect the load from both power sources ("neutral position").

A two-position device type supports open and open in-phase transitions. A three-position device type supports open, open in-phase, open delayed, open load voltage decay and closed transition.



**Power Switch Assembly, Fixed/Drawout
(3000 A Frame, Front View)**

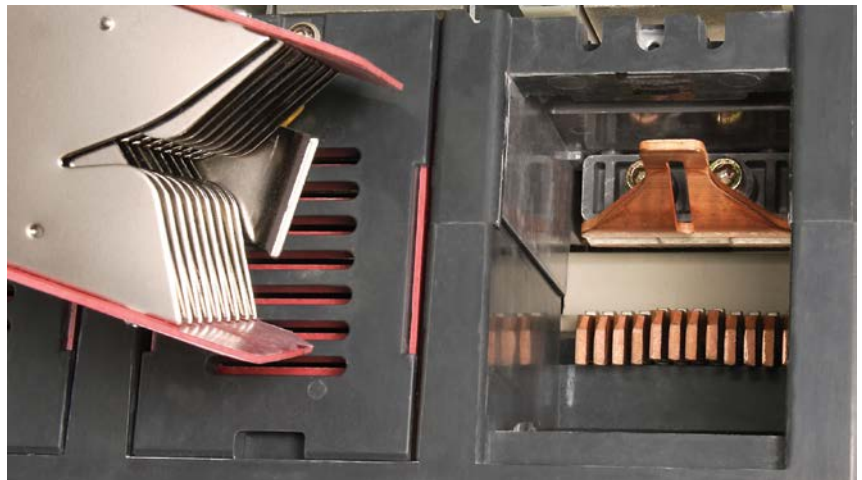

**Main Contacts Within Arc Chamber and Arc Chute
Removed Power Switch Assembly
(3000 A Frame)**

Mounting

Contactor type transfer switches are constructed with a fixed-mounted power switch.

Contactor type bypass isolation automatic transfer switches are constructed with dual drawout power switches or a combination of drawout and fixed. The ATS (lower compartment) is always drawout and the automatic bypass switch (upper compartment) can be configured as fixed or drawout.

Fixed


Fixed-mounted configurations bolt directly to the main bus via pre-drilled primary terminal pads. They are simple and economic because there are no drawout components.

Drawout

A drawout configuration encases the power switch in a steel cassette that includes a control power connection. Finger clusters located at the rear of the cassette slide onto the main bus stabs. Movable extension rails allow the unconnected power switch to be easily levered and drawn out using a standard ratchet drive extension.

Tethered Remote Control

In non-automatic mode, a transfer between sources can be manually initiated and electrically operated using an optional tethered remote control that connects via a standard ethernet cable.

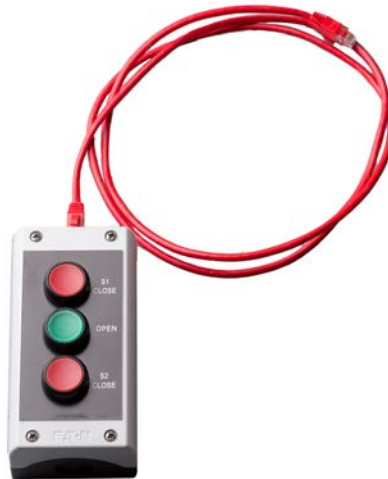

Tethered Control

Lift Devices

Lift trucks/hoists and yokes are available for removing fixed or drawout power switches from the transfer switch.



Hoist Device

Maintenance Isolation Switch

When coupled with a bypass isolation transfer switch having 3-door compartmentalized construction, the maintenance isolation switch (MIS) allows service personnel to more safely perform maintenance while the transfer switch continues to power critical loads.

To mitigate shock hazard the 2-position MIS can be rotated to the maintenance position prior to opening the control compartment door, electrically isolating the control compartment from system and control voltages.

Once isolated, the control compartment door can be opened and adjoining electrical panel slid forward for easy access allowing a technician to more safely inspect, troubleshoot, maintain and repair electrical components. Upon completion, the door is closed and the MIS rotated back to the normal operation position.

Dual Automatic Technology

The bypass isolation transfer switch design includes an automatic bypass switch and an automatic transfer switch (ATS) within a single assembly to provide unparalleled redundancy and uninterrupted power to critical loads.

Both the automatic bypass switch and ATS can be racked out and isolated for regular testing to ensure the entire bypass isolation transfer switch is maintained in proper operating condition. A three-step procedure is printed directly on the control panel. In addition, both switches can be fully withdrawn for visual inspection or completely removed for bench testing without impacting automatic operation. The upper and lower doors open/close independent of each other to maintain electrical isolation of the energized compartment.



Maintenance isolation switch (MIS) electrically isolates the control compartment.



Control compartment door and adjoining electrical panel slide forward.



Safe, easy and spacious access to wiring and components.

Electrical load remains connected to power during maintenance procedures.

Maintaining the Automatic Bypass Switch

With the upper door closed, service personnel can rack out, isolate and test/exercise the automatic bypass switch. With the upper door open, service personnel can drawout the automatic bypass switch for inspection or maintenance. If the connected power source becomes unavailable, the ATS will automatically initiate a transfer.

Maintaining the ATS


With the lower door closed, service personnel can rack out, isolate, and test/exercise the ATS. With the lower door open, service personnel can drawout the ATS for inspection or maintenance. If the connected power source becomes unavailable, the automatic bypass switch will automatically initiate a transfer.



ATC-900 Automatic Controller

Eaton's ATC-900 brings intelligence, adaptability, enhanced supervisory and programming capabilities to Eaton's entire transfer switch product family.

The simple yet powerful user interface includes many intuitive features. The color display and mimic bus with LED indication provide enhanced operator visibility of transfer switch status and metering data. Front arrow keys allow for quick screen navigation, removal of codes and abbreviations avoid potential confusion, and refined data screens provide for ease of viewing and programming.

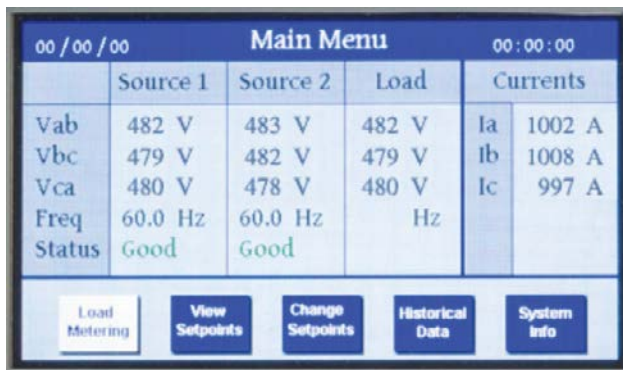

Main Menu					
	Source 1	Source 2	Load	Currents	
Vab	482 V	483 V	482 V	Ia	1002 A
Vbc	479 V	482 V	479 V	Ib	1008 A
Vca	480 V	478 V	480 V	Ic	997 A
Freq	60.0 Hz	60.0 Hz	Hz		
Status	Good	Good			

Navigation buttons: Load Metering, View Setpoints, Change Setpoints, Historical Data, System Info

ATC-900 Main Menu Screen

Primary Features

- Monitor voltage and frequency of normal source, emergency source and load
- Self-acting load transfer between power sources
- Display of real-time and historical information
- Programmable setpoints
- User-configurable control inputs and relay outputs
- Dual engine start/shutdown signaling
- Dual programmable plant exercisers
- Integral load metering
- Detailed and time-stamped event log and history
- Advanced diagnostics and troubleshooting with pre-/post-event data capture
- Download of setpoints, event log and metering data via USB flash drive
- Upload of setpoints and firmware updates via USB flash drive
- Industry standard serial communication
- Symmetrical component calculation
- Record test data to comply with The Joint Commission, NFPA 99 and NEC (700, 701, 708) requirements
- Generator start contacts (Form C) provide means to comply with 695.14(F) and 700.10(D)(3) of the NEC (2017 and 2020)
- ATS Health and Maintenance Watch™

LED mimic diagram

Color-coded LEDs provide status indication. Source 1 Available (white) and Connected (green), Source 2 Available (amber) and Connected (red), Preferred Source (green).

Display and main menu

Provides status at a glance. Source 1, Source 2, and Load status and metering data are displayed. Additional screens are easily accessed using navigation keys.

Arrow key navigation

Right and left arrow keys are used to navigate menu options and up and down arrow keys are used to scroll screens and change setpoint values.

USB port

Download/upload setpoints, events, statistics, meter data, and firmware.



Unit status

LED (green) blinks, indicating that the ATC-900 is operating normally. If the LED is not lit or is on continuously, then a problem condition is indicated.

Help

Displays controller firmware version and user tips.

Lamp test


Pressing the Lamp Test pushbutton lights all LEDs and then displays ATC-900 information.

Engine test

Performs an engine test using the programmed engine run and cool-down times. This is a password-protected feature.

Bypass time delays

Pressing the Enter and Help pushbuttons simultaneously reduces the active programmed time delay to zero.

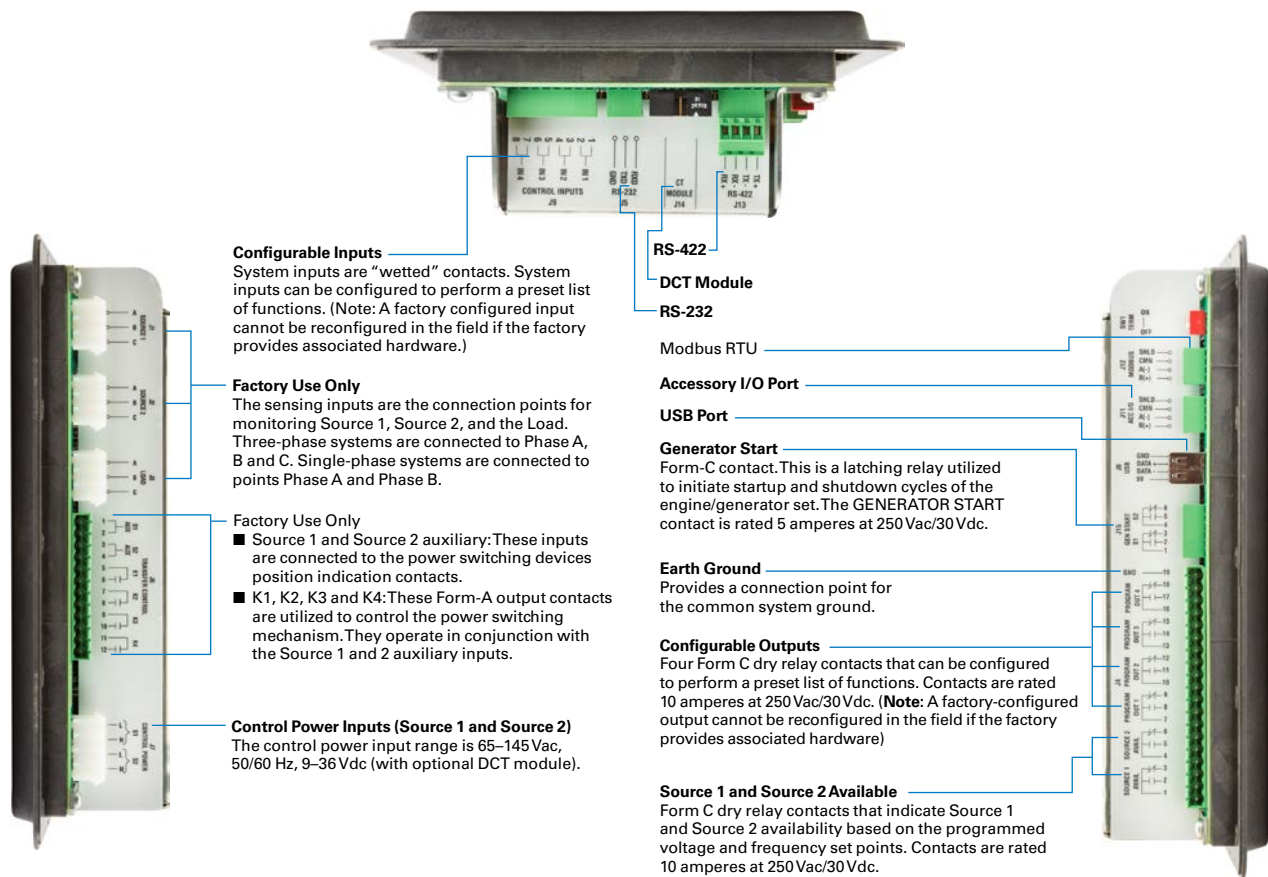

Accessory Modules

The ATC-900 utilizes supporting hardware accessory modules to expand its functionality.

Integral Metering and DC Supply Voltage

An optional DCT module mounts directly to the rear of the ATC-900 and supports the connection of three current transformers via shorting block termination to provide integral power metering (amps, kW, kVA, kvar, PF) complementing standard ATC-900 voltage and frequency monitoring.

24 Vdc can be supplied externally to keep the ATC-900 continuously powered and communicating when the normal and emergency sources are not available.



Load Metering					
Vab	482 V	Ia	1002 A	kW	789
Vbc	479 V	Ib	1008 A	kVAR	261
Vca	480 V	Ic	997 A	kVA	831
Freq	60.0 Hz			PF	.95

Programmable Inputs/Outputs

The ATC-900 standard offering of four programmable inputs and four programmable outputs is expandable by adding I/O modules.

Each I/O module provides an additional four inputs (wetted, 24 Vdc at 10 mA) and four outputs (Form C rated 10 A at 250 Vac/30 Vdc). A maximum of four I/O modules can be daisy-chained for a total of 20 inputs and 20 outputs.



Setpoints - Programmable Inputs	
Input 1	Go To Emergency
Input 2	Emergency Inhibit
Input 3	Preferred Source
Input 4	Bypass Timers
Accessory I/O Modules 0	

Programmable Input Functions

- Monitor mode
- Bypass timer
- Lockout
- Manual retransfer
- Enable manual retransfer
- Secondary control
- Remote engine test
- Preferred source selection
- Go to emergency
- Emergency inhibit/load shed
- ATS on bypass
- Go to neutral position
- Closed transition disable
- Disabled

Programmable Output Functions

- Source 1 available
- Source 2 available
- Source 1 connected
- Source 2 connected
- ATS not in automatic mode
- General alarm
- ATS in test status
- Engine test aborted
- Engine cool-down in process
- Engine 1 start status
- Engine 2 start status
- Emergency inhibit on
- ATS on bypass
- Load sequence
- Selective load shed
- Load bank control
- Pre/post transfer
- Pre-transfer
- Post-transfer
- User remote control
- Health
- Waiting for source sync
- Disabled

Fixed Output Functions

- Source 1 available
- Source 2 available
- Engine start 1
- Engine start 2


Symmetrical Components

The ATC-900 calculates both positive and negative sequence components for voltage and current to determine when abnormal conditions exist that might otherwise go undetected.


An example is a single-phase loss (e.g., open feeder fuse) at the normal source, which would typically cause a transfer to the alternate source.

Once the normal source is unloaded, a condition can develop whereby the single-phase loss is masked due to an induced or “phantom” voltage. If undetected, this could result in a retransfer back to the normal source. Once the normal source is loaded again, the cycle can repeat itself, resulting in continuous power interruptions until the phase loss condition is corrected.

Through the calculation of symmetrical components, the ATC-900 is capable of detecting this abnormal condition and preventing transfer cycling. To protect mechanical loads from potential damage, the ATC-900 can disconnect the load from the normal source (immediately or after a time delay) until the alternate source becomes available.

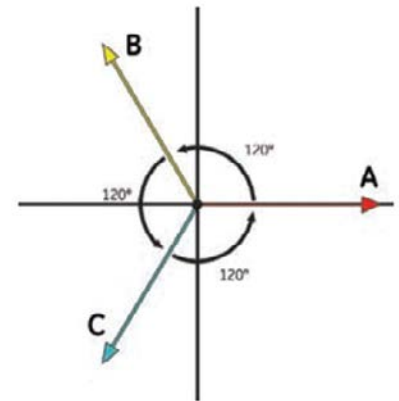

ATC-900 Uses Negative Sequence Components to Detect Abnormal Conditions

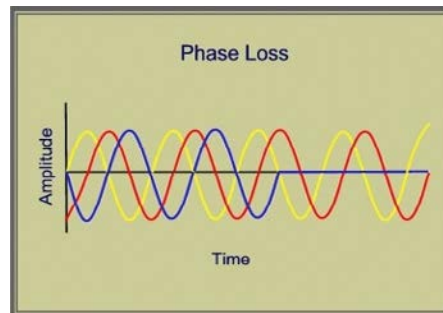

Three Source Arrangement with Primary/Secondary Control

The primary/secondary functionality provides the ability to configure two independent automatic transfer switches in a three-source arrangement consisting of a utility and two generator sources (permanent or portable).


In this configuration, the engine start signal from the primary ATS is wired directly to a programmed control input at the secondary ATS. The engine start 1 and engine start 2 signals at the secondary ATS are wired to the generators. The ATC-900 at the secondary ATS requires a DCT module (fed by an external 24 Vdc supply) to keep the controller powered.

In the event of a utility power failure, the primary ATS engine start relay closes signaling the secondary ATS to start either a preferred generator (if designated) or both generators. Generator start and stop is managed by the secondary ATS. Upon restoration of utility power, the primary ATS engine start relay will open, signaling the secondary ATS to begin generator shutdown.

Load Management

The ATC-900 includes several features, enhancing a user's ability to manage load.

- **Integral load metering:** Monitor load power utilization and compare to baseline measurements
- **Selective load shed:** Drop and pickup non-essential loads when programmed kW threshold levels are reached
- **Emergency inhibit/load shed:** Inhibit or disconnect the load connection to emergency source
- **Pre-/post-transfer:** Control select loads during the transfer process
- **Load bank control:** Disengage a load bank connection from the emergency source upon loss of the normal source
- **Normal source disconnect/reconnect:** When an abnormal power condition is present at the normal source, disconnect the load to prevent potential damage
- **Emergency source disconnect/reconnect:** When an abnormal power condition is present at the emergency source, disconnect the load to prevent potential damage

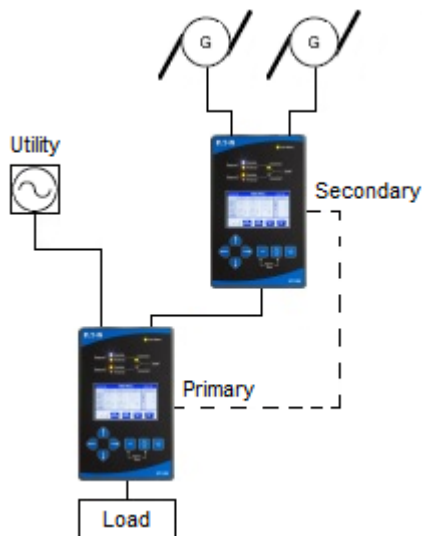

*Primary/Secondary Configuration
with ATC-900*


ATC-300+ Automatic Controller

Eaton's ATC-300+ is a comprehensive, multi-function, microprocessor-based automatic transfer switch (ATS) controller.


It is equipped with a two-line LCD menu and integrated keypad for displaying monitored parameters, programming setpoints, viewing messages and accessing help prompts in an easy to read format.

Primary Features

- Monitor voltage and frequency of normal source and emergency source
- Self-acting load transfer between power sources
- Display of real-time and historical information
- Programmable setpoints
- Control inputs and relay outputs
- Engine start/shutdown signaling (Form C contacts)
- Programmable plant exerciser
- Detailed and time-stamped event log and history
- Diagnostics and troubleshooting with pre-/post-event data capture
- Industry standard serial communication
- Generator start contacts (Form C) provide means to comply with 695.14(F) and 700.10(D)(3) of the NEC (2017 and 2020)

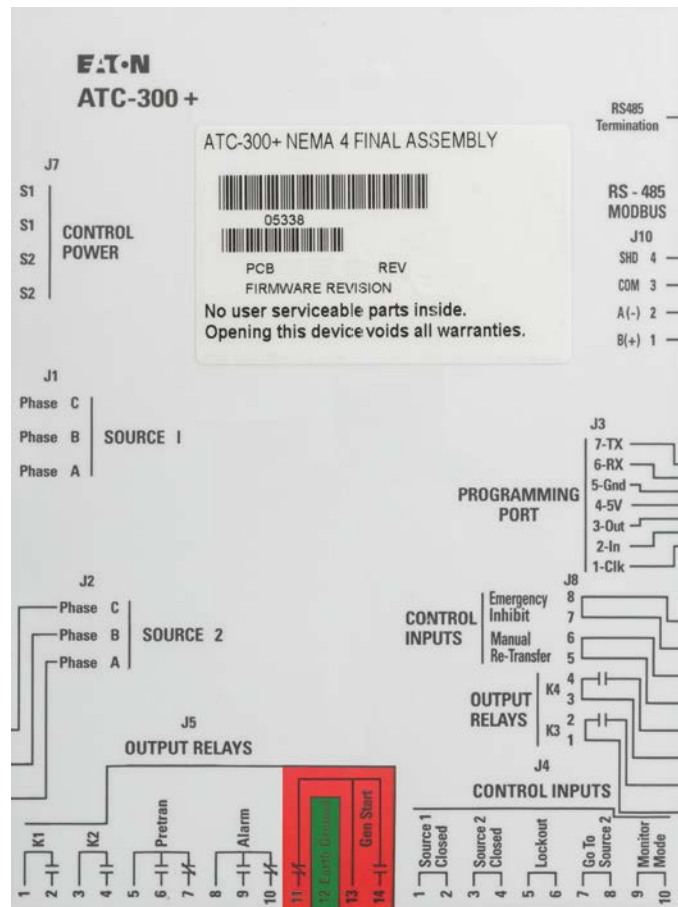


ATC-300+ Controller (Rear View)

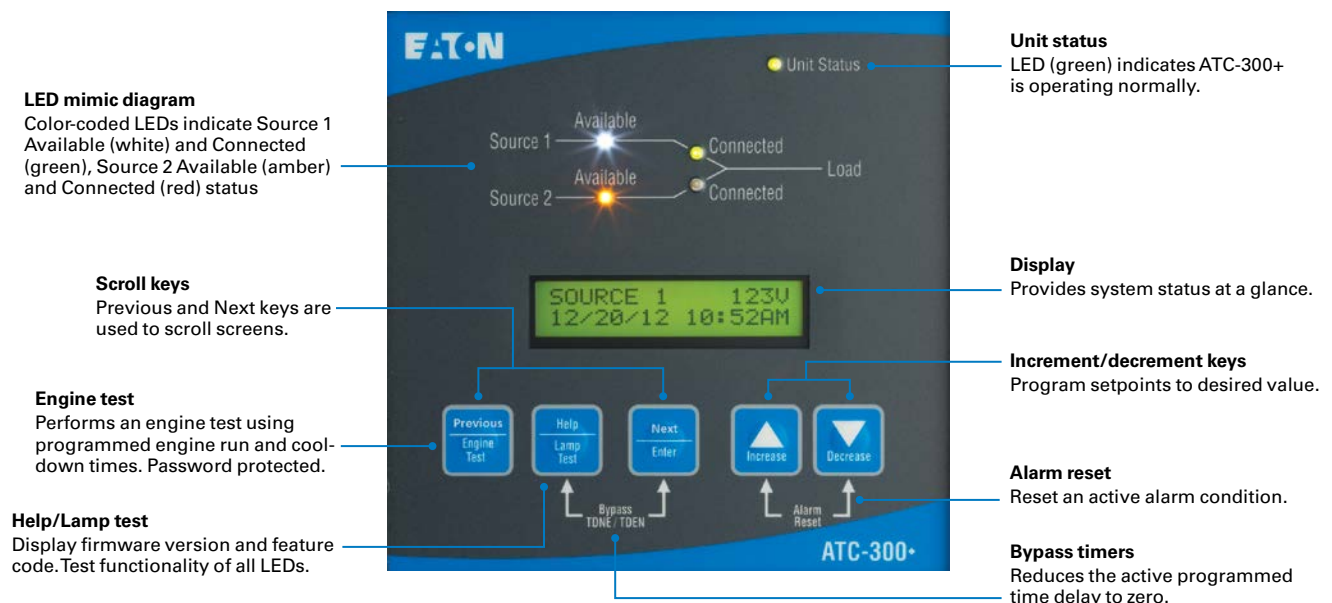

HMi Remote Annunciator Controller



Tightening arc flash regulations and requirements for personal protective equipment are driving more and more end users toward the use of remote monitoring and control devices.

Eaton's HMi Remote Annunciator Controller offers a simple and cost-effective means of monitoring and controlling up to eight automatic transfer switches via serial or ethernet communication.

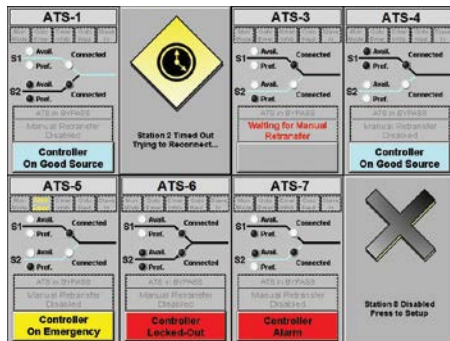

Using one intuitive touch screen interface, users can:

- Monitor source vitals and health
- Analyze metering and trend data of sources and load
- View and program transfer switch controller setpoints, control inputs and relay outputs
- Start and stop a generator engine test
- Initiate a transfer to the alternate source
- Bypass a time delay countdown
- Initiate a manual retransfer
- View and silence alarms
- Perform basic troubleshooting
- Monitor source synchronization during in-phase or closed transition
- View event history
- View the status of up to eight transfer switches on a single overview screen

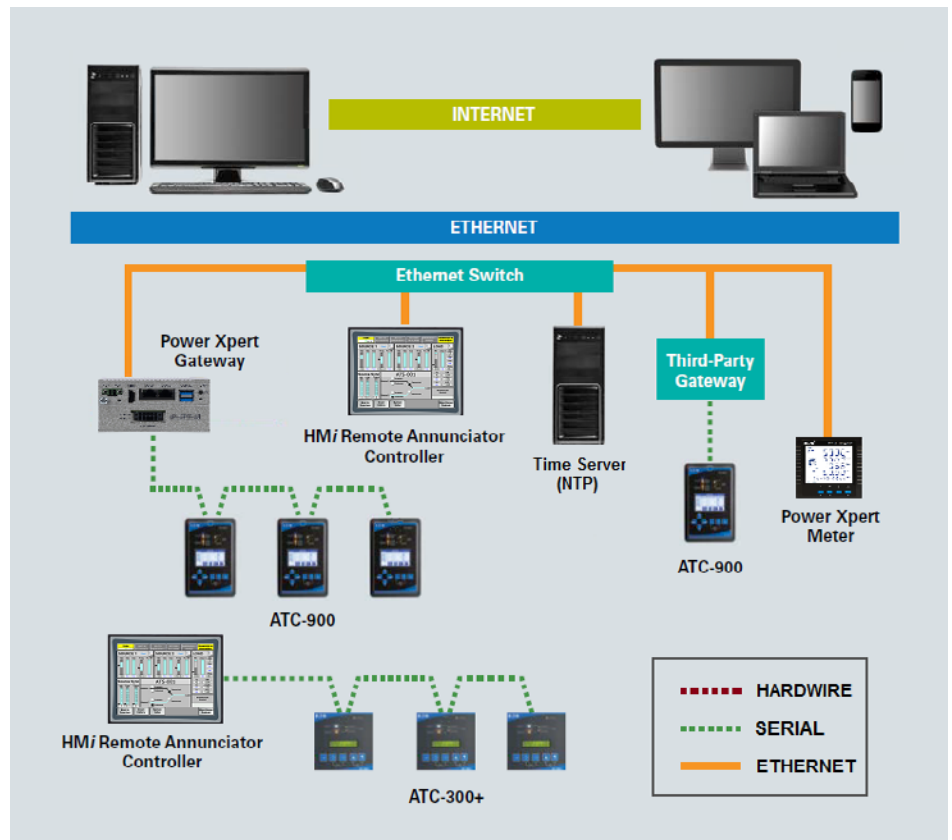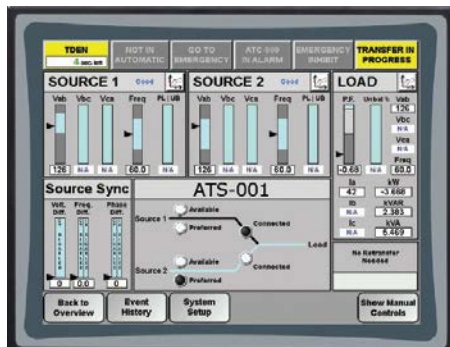

System Architecture

Communication

Eaton transfer switch controllers include native support for serial communication and a Modbus register map is available for interfacing with a building management or power management system. When ethernet communication is desired, there are several modular options available. Modules are typically DIN rail mounted within the enclosure assembly but can be shipped loose.

The Power Xpert PXG 1000 is a full-featured gateway and includes an embedded web server. See Eaton technical document TD152035EN for details.

The ELC-CAENET module is a basic serial to ethernet adapter and supports a variety of protocols. See Eaton document MN05002003E for details.



Advanced Metering

Power Xpert power and energy meters allow owners and operators to interface with their equipment at varying levels of sophistication.

To learn more about Power Xpert Metering products that can be integrated into an Eaton transfer switch, see publication BR140001EN or visit www.eaton.com/meters.

Surge Protection

Surge protection devices can easily be integrated within a transfer switch at the normal (utility) and/or the emergency (generator) power source connection(s).

The purpose of an SPD is to protect electrical and electronic equipment, such as the automatic controller, from damage and degradation due to short duration, high-energy transients. IEEE C62.41.2 describes a number of transient waveforms, with a duration in microseconds or milliseconds, that might be found in an electrical system.

While SPDs do an excellent job of mitigating voltage transients, they are not designed to provide continuous sinusoidal voltage regulation. When an SPD is subjected to a sustained overvoltage, there is a very real danger of the SPD being permanently damaged.

While power obtained from an electric utility typically has very good voltage regulation, a standby or emergency generator may not due to generator undersizing or use of a low-cost voltage regulator.

When specifying an SPD for use on the emergency (generator) side of a transfer switch, the following is an abbreviated list of recommendations. A more detailed discussion can be found in Eaton application paper AP01001003E.


- Utilize an SPD with a delta (3-wire + ground) voltage code for three-phase electrical equipment to improve reliability of the emergency power system
- Specify an SPD with a surge current capacity rating (kA) per the location categories outlined in the latest IEEE C62.41.1 standard. By example, a service entrance transfer switch is considered category C
- Specify a minimum nominal discharge current rating of 20 kA

SPDs are typically equipped with an audible alarm and a Form C relay contact for remote annunciation of status. Some models offer an optional surge counter with nonvolatile storage and reset button.

Control Power Transformer

Transfer switches can easily be field configured for operation with different system voltages via a multi-tap control power transformer (CPT) with keyed quick-disconnect plugs.

Supported three-phase system voltages are 208, 240, 480, 600 Vac (domestic type) and 220, 230, 380, 415 Vac (international type). Either CPT type is available as 60 Hz or 50/60 Hz rated.

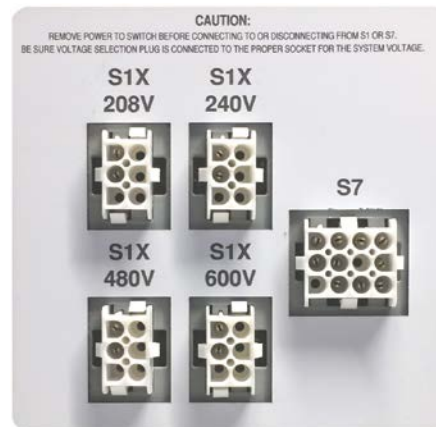

**Multi-Tap Control Power Transformer
(Domestic)**

Thermographic Imaging

Routine inspection of energized conductor terminations in electrical distribution equipment is commonly performed to ensure system reliability and uptime.

Over time, bus joints and cable terminations are often subject to recurring thermal expansion and contraction, which can eventually cause loosened connections resulting in excessive heat. If left unchecked, these "hotspots" can ultimately create an electrical hazard for personnel and/or lead to equipment failure.

One method for periodically verifying the integrity of conductor terminations is to conduct a thermographic scan using an infrared (IR) camera. Line-of-sight is needed between the IR camera and the target termination(s) being scanned, which often requires the equipment enclosure to be fitted with an IR window(s).

IR windows come in various shapes and sizes to accommodate differing target distances and IR camera equipment. A protective cover is typically provided to guard against impact. Based on application needs, power frame transfer switches can optionally be fitted with one or more IR windows as specified by the engineer.



IR Windows

In scenarios where the use of an IR camera is not plausible because of physical limitations, safety concerns or the inability to frequently perform inspections, alternative thermal surveillance technologies can be considered.

Thermal sensors (wired or wireless) are now available commercially and can be positioned within electrical equipment to provide unmanned, 24/7 monitoring of bus and cable connections. Although the idea of real-time monitoring is appealing, replacing a failed thermal sensor could prove challenging, especially in critical operation facilities.

Synchroscope

A synchroscope is a device that monitors and visually indicates electrical synchronization between two power sources. When integrated into a closed transition automatic transfer switch, it tracks the phase angle and frequency difference between a generator and utility source. As the phase angle and frequency differ, so does the synchroscope indication.

When the generator is running “faster” (higher frequency compared to utility), the synchroscope indication rotates clockwise. When the generator is running “slower” (lower frequency compared to utility), the synchroscope indication rotates counterclockwise. As the magnitude of the frequency difference increases, the speed of indication rotation increases. A change in generator frequency is directly related to the speed of the prime mover (e.g., diesel engine). The “position” of synchroscope indication (LED lit at 3 o'clock position) provides the phase angle difference between the two sources.

The position, direction and speed of indication can be used by an operator to make governor adjustments at the prime mover in an effort to synchronize the generator and utility sources.

In some cases, an automatic transfer controller (ATC-900) can provide synchroscope functionality possibly eliminating the need for a separate synchroscope device.



Synchroscope with LED Indication Windows

Protective Relays

Closed transition applications can often require the use of protective relays to meet local utility interconnection requirements that are in place to ensure human safety, minimize possible damage to equipment or property, and sustain electrical power system operation.

Reverse Power Relay

Generally, utility companies will require that the amount of time an alternative power source (e.g., generator) is paralleled with the utility grid be limited to 100 milliseconds. In transfer switch equipment, this is accomplished by the automatic transfer switch logic controller with a discrete parallel limit time relay serving as a failsafe backup. As an additional means of backup, a reverse power relay (IEEE device 32) with a maximum time delay (e.g., 1 second), can be required by the utility company to sense current flowing from the alternative power source to the utility grid. This relay can be used to trip the alternative power source off-line and prevent a prolonged paralleling condition that can damage the alternate power source (motoring).

Lockout Relay

To ensure that a de-energized electrical system (due to a fault condition) is not reenergized by automatic control action, a lockout relay (IEEE device 86) can be required by the utility company to ensure human inspection and/or repair of equipment before the system can be safely placed back into service. In transfer switch equipment, the lockout relay will “lockout or disable” the automatic control logic and prevent reclosure of the tripped power switch/circuit breaker until the relay is manually reset.

Both types of relay devices can easily be integrated into a closed transition transfer switch design upon request.

Standard Layouts

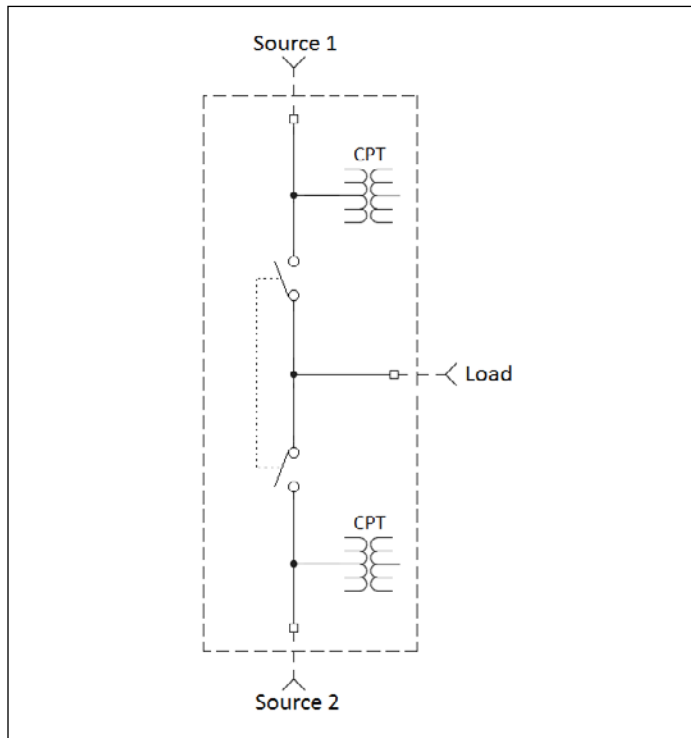


Figure 25.1-1. Contactor Type Transfer Switch

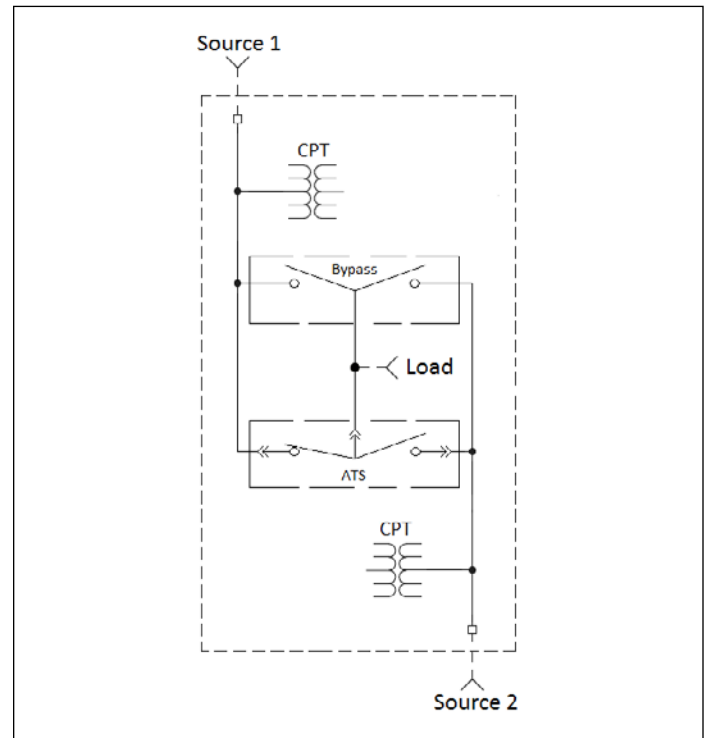


Figure 25.1-3. Contactor Type Bypass Isolation Transfer Switch (Drawout ATS, Fixed Automatic Bypass Switch)

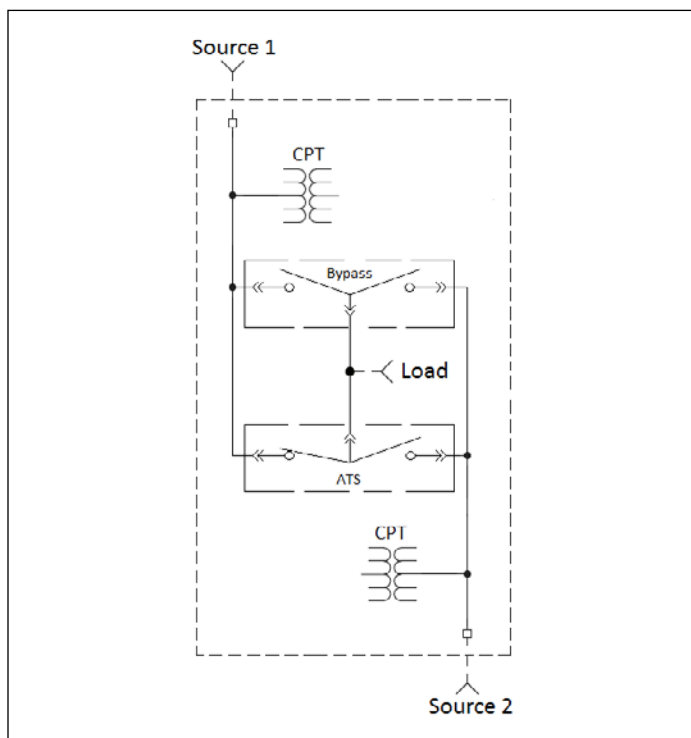


Figure 25.1-2. Contactor Type Bypass Isolation Transfer Switch (Drawout ATS, Drawout Automatic Bypass Switch)

Standard Dimensions and Weights

Table 25.1-3. Contactor-Type Transfer Switches—Dimensions and Shipping Weight ①

Transfer Switch Rating (A)	Device Type	Enclosure	Height in Inches (mm)	Width in Inches (mm)	Depth in Inches (mm)	Normal, Emergency, Load Connection	Neutral ② Connection	Weight in Lb (kg)
40–100	C2	N1, N12, N3R	38.68 (982.5)	18.31 (465.1)	13.34 (338.8)	(1) #14–2/0	(3) #14–1/0	156 (71)
		N4X	37.50 (952.5)	17.50 (444.5)	14.34 (364.2)	(1) #14–2/0	(3) #14–1/0	156 (71)
150–200	C2	N1, N12, N3R	38.68 (982.5)	18.31 (465.1)	13.34 (338.8)	(1) #6–250 kcmil	(3) 1/0–250 kcmil	160 (73) ③ 164 (74) ④
		N4X	37.50 (952.5)	17.50 (444.5)	14.34 (364.2)	(1) #6–250 kcmil	(3) 1/0–250 kcmil	160 (73) ③ 164 (74) ④
225–400	C2	N1, N12, N3R	52.00 (1321.0)	19.81 (503.2)	16.75 (425.5)	(2) 1/0–250 kcmil/ (1) 1/0–750 kcmil	(6) 250–500 kcmil	250 (113) ③ 260 (118) ④
		N4X	52.00 (1321.0)	21.00 (533.4)	16.75 (425.5)	(2) 1/0–250 kcmil/ (1) 1/0–750 kcmil	(6) 250–500 kcmil	250 (113) ③ 260 (118) ④
40–100	C3, C5	N1, N12, N3R	52.00 (1321.0)	19.81 (503.2)	16.75 (425.5)	(1) #14–1/0	(3) #14–2/0	250 (113) ③ 260 (118) ④
		N4X	52.00 (1321.0)	21.00 (533.4)	16.75 (425.5)	(1) #14–1/0	(3) #14–2/0	250 (113) ③ 260 (118) ④
150–200	C3, C5	N1, N12, N3R	52.00 (1321.0)	19.81 (503.2)	16.75 (425.5)	(1) #6–250	(3) 1/0–250 kcmil	250 (113) ③ 260 (118) ④
		N4X	52.00 (1321.0)	21.00 (533.4)	16.75 (425.5)	(1) #6–250	(3) 1/0–250 kcmil	250 (113) ③ 260 (118) ④
225–400	C3, C5	N1, N12, N3R	52.00 (1321.0)	19.81 (503.2)	16.75 (425.5)	(2) 1/0–250 kcmil/ (1) 1/0–750 kcmil	(6) 250–500 kcmil	250 (113) ③ 260 (118) ④
		N4X	52.00 (1321.0)	21.00 (533.4)	16.75 (425.5)	(2) 1/0–250 kcmil/ (1) 1/0–750 kcmil	(6) 250–500 kcmil	250 (113) ③ 260 (118) ④
600	C3, C5	N1, N3R	79.41 (2017.0)	25.25 (641.4) ③ 29.19 (741.4) ④	22.46 (570.5)	(2) 1/0–750 kcmil	(12) 1/0–750 kcmil	600 (272) ③ 650 (295) ④
		N12, N4X	84.75 (2152.7)	29.00 (737.0)	24.26 (616.2)	(2) 1/0–750 kcmil	(12) 1/0–750 kcmil	700 (318) ③ 750 (340) ④
800–1200	C3, C5	N1, N3R	79.41 (2017.0)	25.25 (641.4) ③ 29.19 (741.4) ④	22.46 (570.5)	(4) 1/0–750 kcmil	(12) 1/0–750 kcmil	600 (272) ③ 650 (295) ④
		N12, N4X	84.75 (2152.7)	29.00 (737.0)	24.26 (616.2)	(4) 1/0–750 kcmil	(12) 1/0–750 kcmil	700 (318) ③ 750 (340) ④
1600	C3, C5	N1	90.00 (2286.0)	40.00 (1016.0)	29.00 (737.0)	(4) 1/0–750 kcmil	(12) 1/0–750 kcmil	1090 (494) ③ 1150 (522) ④
		N3R	90.72 (2304.3)	40.35 (1024.9)	47.59 (1209.0)	(4) 1/0–750 kcmil	(12) 1/0–750 kcmil	1200 (544) ③ 1260 (571) ④
2000	F5, G5	N1	90.00 (2286.0)	40.00 (1016.0)	40.00 (1016.0)	(8) 1/0–750 kcmil	(24) 1/0–750 kcmil	1400 (635) ③ 1500 (680) ④
		N3R	90.00 (2286.0)	40.00 (1016.0)	58.59 (1488.2)	(8) 1/0–750 kcmil	(24) 1/0–750 kcmil	1850 (839) ③ 1900 (862) ④
2600–3000	F5, G5	N1	90.00 (2286.0)	40.00 (1016.0)	40.00 (1016.0)	(12) 1/0–750 kcmil	(36) 1/0–750 kcmil	1400 (635) ③ 1500 (680) ④
		N3R	90.00 (2286.0)	40.00 (1016.0)	58.59 (1488.2)	(12) 1/0–750 kcmil	(36) 1/0–750 kcmil	1850 (839) ③ 1900 (862) ④

① Dimensions and weights are applicable to standard open transition product configuration at 480 V and subject to change. Please reference product outline drawings for the latest detailed information.

② Neutral connection size listed is for product configuration with a solid neutral. For product configurations with a switched neutral (four-pole), reference the size listed in the Emergency/Load Connection column.

③ Three-pole product configuration.

④ Four-pole product configuration.

Table 25.1-4. Service Entrance Contractor-Type Transfer Switches—Dimensions and Shipping Weight ①

Transfer Switch Rating (A)	Device Type	Enclosure	Height in Inches (mm)	Width in Inches (mm)	Depth in Inches (mm)	Normal Connection	Emergency, Load Connection	Neutral ② Connection	Weight in Lb (kg)
40–100	C2	N1, N12, N3R	52.00 (1321.0)	19.81 (503.2)	16.75 (425.5)	(1) #8–350	(1) #14–2/0	(3) #14–1/0	240 (109)
150–200	C2	N1, N12, N3R	52.00 (1321.0)	19.81 (503.2)	16.75 (425.5)	(1) #8–350	(1) #6–250 kcmil	(3) 1/0–250 kcmil	300 (136)
225–400	C2	N1, N3R	79.00 (2006.6)	25.25 (641.4)	22.46 (570.5)	(2) #2–500	(2) 1/0–250 kcmil/ (1) 1/0–750 kcmil	(6) 250–500 kcmil	500 (227)
40–100	C3, C5	N1, N3R	79.00 (2006.6)	25.25 (641.4)	22.46 (570.5)	(1) #8–350	(1) #14–2/0	(3) #14–1/0	500 (227)
150–200	C3, C5	N1, N3R	79.00 (2006.6)	25.25 (641.4)	22.46 (570.5)	(1) #8–350	(1) #6–250	(3) 1/0–250 kcmil	500 (227)
225–400	C3, C5	N1, N3R	79.00 (2006.6)	25.25 (641.4)	22.46 (570.5)	(2) #2–500	(2) 1/0–250 kcmil/ (1) 1/0–750 kcmil	(6) 250–500 kcmil	500 (227)
600–800	C3, C5	N1, N3R	79.00 (2006.6)	40.37 (1025.4)	22.59 (573.8)	(4) 4/0–500	(4) 1/0–750 kcmil	(12) 4/0–500 kcmil	900 (409)
1000	C3, C5	N1	79.00 (2006.6)	40.37 (1025.4)	22.59 (573.8)	(4) 4/0–500	(4) 1/0–750 kcmil	(12) 4/0–500 kcmil	900 (409)
		N3R	90.00 (2286.0)	40.00 (1016.0)	66.80 (1697.0)	(4) 500–1000 kcmil	(4) 1/0–750 kcmil	(12) 4/0–500 kcmil	1700 (771) ③ 1850 (839) ④
1200	C3, C5	N1	90.00 (2286.0)	40.00 (1016.0)	48.00 (1219.2)	(4) 500–1000 kcmil	(4) 1/0–750 kcmil	(12) 4/0–500 kcmil	1340 (608) ③ 1700 (771) ④
		N3R	90.00 (2286.0)	40.00 (1016.0)	66.80 (1697.0)	(4) 500–1000 kcmil	(4) 1/0–750 kcmil	(12) 4/0–500 kcmil	1700 (771) ③ 1850 (839) ④
1600	C3, C5	N1	90.00 (2286.0)	40.00 (1016.0)	48.00 (1219.2)	(4) 500–1000 kcmil	(4) 1/0–750 kcmil	(18) 1/0–750 kcmil	1440 (653) ③ 1700 (771) ④
		N3R	90.00 (2286.0)	40.00 (1016.0)	66.80 (1697.0)	(4) 500–1000 kcmil	(4) 1/0–750 kcmil	(18) 1/0–750 kcmil	1850 (839)

① Dimensions and weights are applicable to standard open transition product configuration at 480 V and subject to change. Please reference product outline drawings for the latest detailed information.

② Neutral connection size listed is for product configuration with a solid neutral. For product configurations with a switched neutral (four-pole), reference the size listed in the Emergency/Load Connection column.

③ Three-pole product configuration.

④ Four-pole product configuration.

Table 25.1-5. Contactor-Type Bypass Isolation Automatic Transfer Switches—Dimensions and Shipping Weight ①

Transfer Switch Rating (A)	Device Type	Enclosure	Height in Inches (mm)	Width in Inches (mm)	Depth in Inches (mm)	Normal, Emergency, Load Connection	Neutral ② Connection	Weight in Lb (kg)
100–200	C3, C5	N1	78.07 (1983.0)	30.00 (762.0)	29.30 (744.0)	(1) #6–350	(3) 1/0–750	1300 (590) ③ 1360 (617) ④
		N3R	78.07 (1983.0)	30.00 (762.0)	47.59 (1209.0)	(1) #6–350	(3) 1/0–750	1550 (703) ③ 1650 (748) ④
		N12	90.00 (2286.0)	46.00 (1168.0)	38.00 (965.0)	(1) #6–350	(3) 1/0–750	1325 (601) ③ 1350 (612) ④
		N4X	90.00 (2286.0)	46.00 (1168.0)	38.00 (965.0)	(1) #6–350	(3) 1/0–750	1362 (618) ③ 1388 (629) ④
225–400	C3, C5	N1	78.07 (1983.0)	30.00 (762.0)	29.30 (744.0)	(1) 1/0–750 (2) 1/0–250	(3) 1/0–750	1300 (590) ③ 1360 (617) ④
		N3R	78.07 (1983.0)	30.00 (762.0)	47.59 (1209.0)	(1) 1/0–750 (2) 1/0–250	(3) 1/0–750	1550 (703) ③ 1650 (748) ④
		N12	90.00 (2286.0)	46.00 (1168.0)	38.00 (965.0)	(1) 1/0–750 (2) 1/0–250	(3) 1/0–750	1325 (601) ③ 1350 (612) ④
		N4X	90.00 (2286.0)	46.00 (1016.0)	38.00 (965.0)	(1) 1/0–750 (2) 1/0–250	(3) 1/0–750	1362 (618) ③ 1388 (629) ④
600	C3, C5	N1	90.00 (2286.0)	40.00 (762.0)	29.00 (737.0)	(2) 1/0–750 (4) 1/0–250	(6) 1/0–750 (12) 1/0–250	1780 (807) ③ 1820 (825) ④
		N3R	90.72 (2304.0)	40.35(1025.0)	47.59 (1209.0)	(2) 1/0–750 (4) 1/0–250	(6) 1/0–750 (12) 1/0–250	1850 (839) ③ 1890 (857) ④
		N12	90.00 (2286.0)	46.00 (1168.0)	38.00 (965.0)	(2) 1/0–750 (4) 1/0–250	(6) 1/0–750 (12) 1/0–250	1880 (853) ③ 1930 (875) ④
		N4X	90.00 (2286.0)	46.00 (1168.0)	38.00 (965.0)	(2) 1/0–750 (4) 1/0–250	(6) 1/0–750 (12) 1/0–250	1954 (886) ③ 2006 (910) ④
800–1200	C3, C5	N1	90.00 (2286.0)	40.00 (1016.0)	29.00 (737.0)	(4) 1/0–750 (8) 1/0–250	(12) 1/0–750	1900 (862) ③ 1965 (891) ④
		N3R	90.72 (2304.0)	40.35(1025.0)	47.59 (1209.0)	(4) 1/0–750 (8) 1/0–250	(12) 1/0–750	2035 (923) ③ 2100 (952) ④
		N12	90.00 (2286.0)	46.00 (1168.0)	38.00 (965.0)	(4) 1/0–750 (8) 1/0–250	(12) 1/0–750	2080 (943) ③ 2130 (966) ④
		N4X	90.00 (2286.0)	46.00 (1168.0)	38.00 (965.0)	(4) 1/0–750 (8) 1/0–250	(12) 1/0–750	2154 (977) ③ 2206 (1000) ④
1600	C3, C5	N1	90.00 (2286.0)	40.00 (1016.0)	40.00 (1016.0)	(5) 1/0–750 (10) 1/0–250	(16) 1/0–750	2170 (984) ③ 2425 (1100) ④
		N3R	90.69 (2304.0)	40.00 (1016.0)	58.59 (1488.0)	(5) 1/0–750 (10) 1/0–250	(16) 1/0–750	2526 (1146) ③ 2800 (1270) ④
2000	F5, G5	N1	90.00 (2286.0)	44.00 (1118.0)	60.00 (1524.0)	(8) 1/0–750	(24) 1/0–750	3340 (1515) ③ 3800 (1723) ④
		N3R	90.69 (2304.0)	40.00 (1016.0)	78.80 (2020.0)	(8) 1/0–750	(24) 1/0–750	3644 (1653) ③ 4100 (1859) ④
2600–3000	F5, G5	N1	90.00 (2286.0)	44.00 (1118.0)	60.00 (1524.0)	(12) 1/0–750	(24) 1/0–750	3340 (1515) ③ 3800 (1723) ④
		N3R	90.69 (2304.0)	40.00 (1016.0)	78.80 (2020.0)	(12) 1/0–750	(24) 1/0–750	3644 (1653) ③ 4100 (1859) ④

① Dimensions and weights are applicable to standard open transition product configuration at 480 V and subject to change. Please reference product outline drawings for the latest detailed information.

② Neutral connection size listed is for product configuration with a solid neutral. For product configurations with a switched neutral (four-pole), reference the size listed in the Emergency/Load Connection column.

③ Three-pole product configuration.

④ Four-pole product configuration.

Usual Environmental Conditions

Ambient Temperature

- Operation: -20 °C to +40 °C (-4 °F to +104 °F)
- Storage: -30 °C to +80 °C (-22 °F to +176 °F)

Relative Humidity

- Operation: up to 90% (noncondensing)
- Altitude: Product voltage and current ratings are applicable up to a maximum altitude of 2000 m (6562 ft) above sea level

Unusual Environmental Conditions

Special attention should be given to applications subject to the following conditions:

1. Excessive dust or flyings

It is generally recommended that the transfer switch be installed in a clean, dry room with filtered and/or pressurized clean air. Air filters and gasketing material can be added to ventilated enclosures upon request.

2. Excessive moisture

Depending upon conditions, an internal thermostat-controlled heater may be indicated to mitigate condensation. Additionally, stainless-steel enclosure designs are available.

3. Excessive altitude

When a transfer switch installation exceeds 2000 m (6562 ft) in altitude, voltage and current ratings are subject to the following derating factors based on ANSI C37.20.1

Table 25.1-6. Altitude Derating

Meters	Feet	Voltage	Current
2000	6562	1.0	1.0
2134	7000	0.989	0.998
2286	7500	0.976	0.995
2438	8000	0.963	0.993
2591	8500	0.950	0.990
2743	9000	0.933	0.987
2896	9500	0.917	0.983
3048	10,000	0.900	0.980
3200	10,500	0.883	0.977
3353	11,000	0.867	0.973
3505	11,500	0.850	0.970
3658	12,000	0.833	0.967
3810	12,500	0.817	0.963
3962	13,000	0.800	0.960

Note: Values for intermediate altitudes may be derived by linear interpolation.

4. Excessive high or low temperatures

For ambient temperatures exceeding 40 °C, and based on a standard temperature rise of 65 °C, the continuous current rating of the transfer switch is subject to the following thermal derating based on ANSI C37.20.1:

$$I_a = I_r \sqrt{\frac{105^\circ\text{C} - \text{Special Ambient, } ^\circ\text{C}}{65^\circ\text{C}}}$$

where:

I_a is the derated continuous current (amperes) at the special ambient temperature

I_r is the rated continuous current (amperes), on the basis of 40 °C ambient temperature

5. Damaging or hazardous vapors

For installations in corrosive environments where standard silver-plated bus is subject to “whiskering” in the presence of hydrogen sulfide (e.g., wastewater treatment facilities), tin-plated bus can be provided to mitigate whisker length to a few millimeters.

Heat Loss

Estimated heat loss of the transfer switch (fixed and drawout mount) is based on operation at 100% of the continuous current rating.

Table 25.1-7. Estimated Heat Loss

Current Rating (Amperes)	Fixed Mount (Watts)	Drawout Mount (Watts)
40	21	20
80	31	25
100	38	28
150	30	41
200	39	60
225	44	71
260	45	72
400	82	145
600	106	194
800	174	331
1000	243	467
1200	342	665
1600	727	1435
2000	220	421
2600	245	586
3000	320	774

Transfer Switches



Automatic Transfer Switch Family

General Description

Eaton's low-voltage automatic transfer switch assemblies provide a reliable means of transferring essential load connections between primary and alternate sources of electrical power.

Data centers, hospitals, factories and a wide range of other facility types that require continuous or near continuous uptime typically utilize an emergency (alternate) power source, such as a generator or a backup utility feed, when their normal (primary) power source becomes unavailable.

When the normal power source fails, the transfer switch quickly and safely transitions the load connections to the emergency power source, allowing critical loads to continue running with minimal or no interruption. All electrical power consumed by the circuit, equipment or system connected to the transfer switch output is defined as the load.

A typical transfer sequence includes these steps:

1. The normal utility power source fails.
2. When power from the generator or backup utility feed is stable and within prescribed voltage and frequency tolerances, the transfer switch shifts the load to the emergency power source. Depending on a facility's needs and preferences, the transfer process is self-acting or manually initiated.
3. When utility power is restored, the transfer switch returns the load from the emergency power source to the normal power source. The retransfer process is self-acting or manually initiated.

Arrangements

Two Power Sources

Utility—Generator

The standard transfer switch use case includes an electric utility service and an engine-generator set (generator) providing the normal and emergency power sources. This system arrangement is typically referred to as an emergency standby generator system. The single generator shown may be several engine-generator sets operating in parallel.

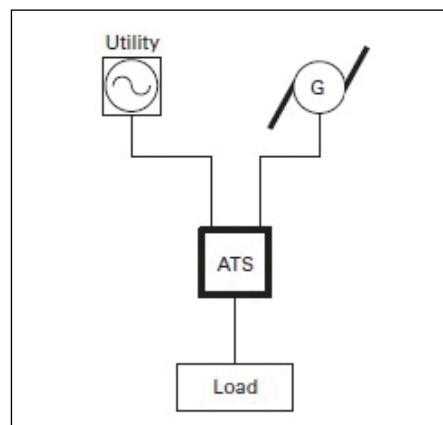


Figure 25.1-4. Utility—Generator

Utility—Utility

This use case employs two utility sources providing some level of redundancy in the distribution system and allows for quick restoration of service to the load if an upstream equipment failure occurs.

The two sources can be independent of each other, requiring the public utility company to provide dual electric services, or they can originate from a single electric service that is distributed through redundant paths within the facility.

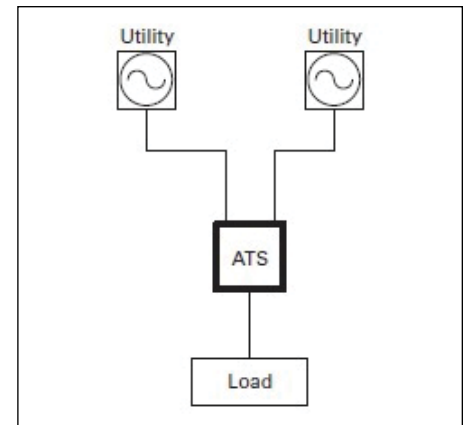


Figure 25.1-5. Utility—Utility

Generator—Generator

Transfer switches are sometimes applied between two generator sets for prime power use, often at remote installations. In such cases, the generator may be required to provide continuous power 24/7. As a means to equally share run-time, source power is periodically alternated between the generator sets.

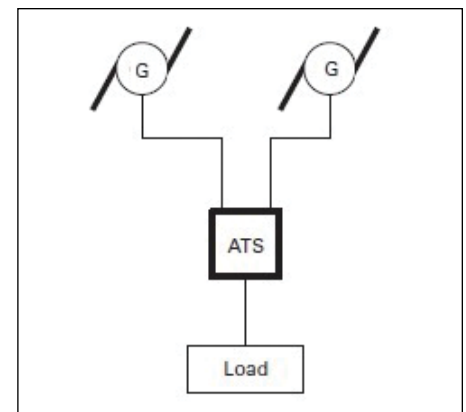


Figure 25.1-6. Generator—Generator

Three Power Sources

Utility—Generator—Generator

Critical facilities with an emergency standby generator system will often include provisions for a second generator connection to serve as a redundant emergency backup that can be used during periods of inclement weather or when scheduled maintenance is being performed on the first generator.

In some cases, the first generator is permanently installed on-site whereas the second generator will be a portable roll-up type that is deployed when needed. Two variations of this arrangement are shown. When configured as shown in the first example, the generator start circuits must be managed to prevent unnecessary running when the utility source is available.

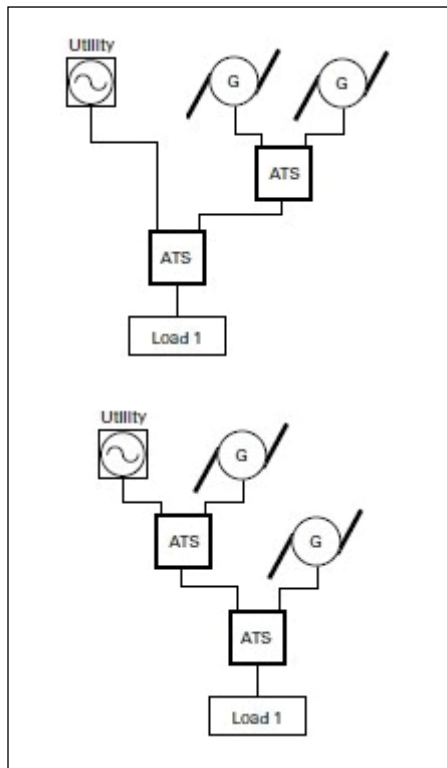


Figure 25.1-7. Utility—Generator—Generator

Three Power Sources

Utility—Utility—Generator

This use case expands on the redundancy provided by dual utility arrangement and includes an emergency standby generator source. The generator can be dedicated for use by a single transfer switch or shared among multiple transfer switches employing a priority control scheme. Two variations of this arrangement are shown.

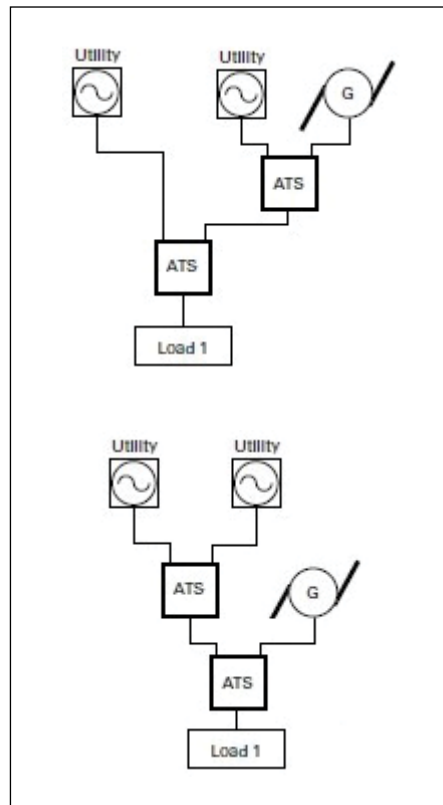


Figure 25.1-8. Utility—Utility—Generator

Transition Types

Transfer switches can transition loads between normal and emergency power sources in two basic ways: open or closed.

The specific functions performed by a given load and the importance of those functions to safety or security play an important role in determining which kind of transition is required.

Open Transition

An open transition is a “break before make” transfer. That is, the transfer switch breaks its connection to one power source before making a connection to the other. For some period of time between disconnection and connection, neither the normal power source nor the emergency source is providing electricity to downstream loads. There are two kinds of open transition: open delayed and open in-phase.

Open Delayed Transition

For an open delayed transition, the transfer switch pauses in-between disconnecting the load from one power source and connecting it to the other power source. The delay typically lasts either a pre-set amount of time (fixed or programmed time delay) or however long it takes the load voltage to decay below a pre-specified level (programmed threshold). The load voltage decay approach is more precise.

Open In-Phase Transition

With open in-phase transition, an automatic controller uses built-in intelligence to execute an open transition at the precise moment it expects the normal and emergency power sources to be synchronized in phase, voltage and frequency.

In-phase transitions are typically completed in 150 milliseconds or less to ensure that inrush current is equal to or less than the normal starting current of any inductive load(s).

If synchronization doesn’t occur within this time span, the transfer switch may have the ability to default automatically to a delayed transition that serves as a failsafe.

Closed Transition

A closed transition is a “make before break” transfer, in that the transfer switch makes a connection to a second power source before breaking its connection with the first power source. As there’s no gap between disconnection and connection, downstream loads receive continuous power throughout the transfer process.

Switches configured for closed transition transfer power automatically as soon as both power sources are closely synchronized in phase, voltage and frequency. The overlap period during which both sources are simultaneously connected, or “paralleled,” usually lasts no more than 100 milliseconds to comply with local utility interconnect requirements.

Modes of Operation

Power transfers involve two processes: initiation and operation. Initiation is what starts the transfer. Operation is what completes it. Most transfer switches can support multiple operation modes through the addition of configurable options.

Manual Mode

In manual mode, both initiation and operation are performed manually, typically by pushing a button or moving a handle. Initiation occurs locally.

Non-Automatic Mode

In non-automatic mode, the operator manually initiates a transfer by pressing a button or rotating a switch that causes an internal electromechanical device to electrically operate the switching mechanism. Initiation can occur locally or remotely.

Automatic Mode

In automatic mode, the transfer switch controller is self-acting and completely manages both initiation and operation. Initiation is triggered when the automatic controller senses an unavailability or loss of source power followed by operation of the switching mechanism.



Power Frame Switching Mechanisms are Available up to 5000 A and Utilize Stored Energy Technology

Switching Mechanism

The switching mechanism is the part of a transfer switch that is physically responsible for carrying the rated electrical current and shifting the load connection from one power source to another.

Low-voltage switching mechanism technology comes in two basic varieties, commonly referred to as “contactor type” and “circuit breaker type.” Circuit breaker switching mechanisms can be further divided into two sub-types: molded case and power frame.

Contactor Type

This is the most common and typically most economical switching mechanism type. Contactors are constructed as an electrically controlled, double-throw switch where a single operator opens one set of power contacts while closing a second set. In an open transition design, a mechanical interlock is often employed to prevent simultaneous closure of both contact sets. In a closed transition design, the mechanical interlock is absent. Unlike a circuit breaker, a contactor is not designed to provide overcurrent protection or interrupt short-circuit fault current.

Contactor switching mechanisms are fast and flexible, but do not offer overcurrent protection.



Contactor switching mechanisms

Molded Case Type

Routinely used for closing and interrupting a circuit between separable contacts under both normal and abnormal conditions, molded case switches feature simple designs and are capable of supporting either a mechanically operated, over-center toggle or a motor operator. They are typically assembled in an enclosed housing constructed of insulating material.

When configured for use in a transfer switch, a pair of molded case switches are operated via a common, interlocking mechanical linkage. The linkage can be driven manually or automatically. When overcurrent protection is needed, molded case circuit breakers equipped with a thermal-magnetic or electronic trip element are used.

Molded case switching mechanisms provide a compact, cost-effective and service entrance-rated solution, as they eliminate the need for additional upstream protective devices. Each molded case mechanism individually complies with industry standard UL 489, which covers low-voltage molded case switches and circuit breakers.

Molded case switching mechanisms are ideal for applications that require integral overcurrent protection.



Molded case switching mechanisms

Power Frame Type

Power frame switches are larger, faster and more powerful than molded case switches and are capable of handling up to 5000 A.

A two-step stored energy technology is utilized, which permits manual and electrical operation under load.

When an application requires integral overcurrent protection, power circuit breakers are configured with an electronic trip unit that facilitates selective coordination.

Power frame switching mechanisms are a good fit for applications vulnerable to large fault currents.

Each power frame switch or circuit breaker individually complies with industry standard UL 1066, which covers low-voltage power circuit breakers.



**Power Frame Switching Mechanisms
are Available up to 5000 A and Utilize
Stored Energy Technology**

Note: For more detail, reference Eaton Publication WP140001EN.

Mounting

Drawout

The use of drawout construction permits the switching mechanism to be levered into three different positions (connected, disconnected, withdrawn) within a cassette or cell structure facilitating safety, testing and serviceability. Drawout is typically achieved using rail slides or rollers.

When in the disconnected position, the switching mechanism is isolated from the main power bus or cabling. Some designs may allow the switching mechanism to be manually or electrically (via control power) exercised to satisfy preventive maintenance requirements. Placing the switching mechanism in the disconnected position can also be used during a lockout/tagout procedure.

Removing the switching mechanism from the transfer switch allows for bench testing or replacement.

Drawout construction is often employed in bypass isolation type transfer switches used in mission-critical applications.



Drawout Mounting

Fixed

Switching mechanisms with a fixed mounting configuration are simple and economical because there are no drawout system components.

The switching mechanism bolts directly to the main power bus or cable conductors and may result in a reduced enclosure depth when compared to drawout.



Fixed Mounting

Power Poles

Every transfer switch includes a specific number of power poles. Two- and three-pole designs are commonly employed in locations fed by single-phase power whereas three- and four-pole designs are utilized in places supplied with three-phase power.

Each power pole is constructed with two sets of main contacts (momentary and stationary components) that are interconnected to form a three-terminal, single-pole switch. This arrangement allows the load terminal to be connected with one or both power source terminals.

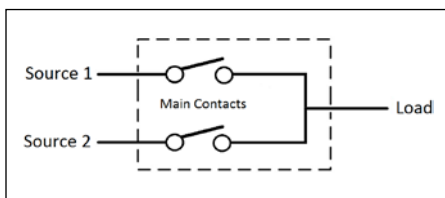


Figure 25.1-9. Power Pole

Power poles are used to switch individual phase conductors of the power source and where required, the neutral conductor.

When multiple power poles are combined with an operator device(s), a switching mechanism is formed.

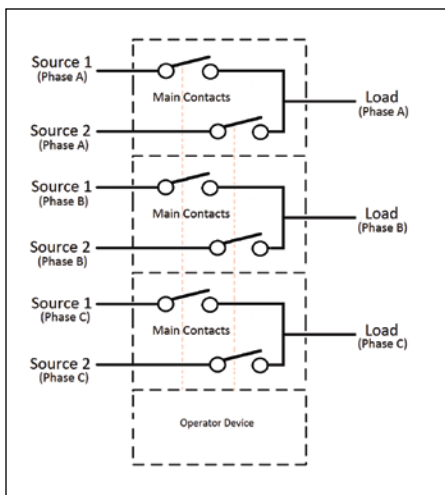


Figure 25.1-10. Switching Mechanism

For simplicity, multiple power poles are eliminated from the common transfer switch symbol used in one-line drawings.

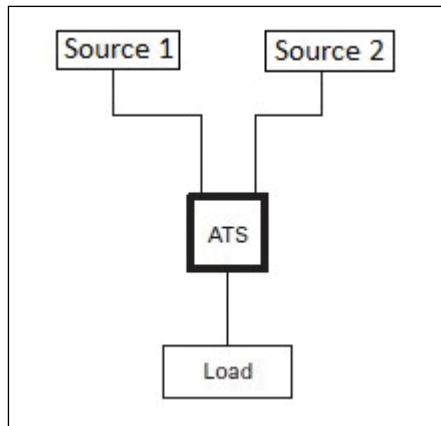


Figure 25.1-11. Transfer Switch Schematic Drawing

In open transition transfer switches, the main contacts are mechanically interlocked, preventing both sets from being closed at the same time. This action prevents the inadvertent electrical paralleling of the two power sources that can differ in voltage, frequency and phase.

Closed transition designs do not include a mechanical interlock and will permit simultaneous paralleling of the power sources when they are electrically synchronized, however, an electrical interlock is used to limit the paralleling time (typically 100 ms) to comply with public utility interconnect specifications.

Power poles also include features to mitigate arcing and erosion of the main contacts such as arcing contacts, arc runners and arc chutes.

Arc Chutes

Switching mechanisms include arc chutes, housed within an arc chamber constructed of high-dielectric high-strength material, that are mounted over each set of main contacts. Arc chutes are constructed of metal plates designed to extinguish an electrical arc and protect the main contacts.



Arc Chutes

Operator Device

The operator device drives the power pole main contacts open or closed. Depending on the switching mechanism type, this is accomplished using an electric solenoid, electric motor or a spring stored energy mechanism.

Some operator device designs allow the source 1 main contacts to be driven independently of the source 2 main contacts. This permits the load to remain disconnected from either of the power sources for a programmed time delay or until the residual load voltage decays below a programmed threshold. When the load is disconnected in this manner, the transfer switch is said to be in a center-off or "neutral-position".

Contactor type switching mechanisms that provide a "neutral-position" are referred to as 3-position, otherwise, they are termed 2-position. All molded case and power frame type switching mechanisms provide a "neutral-position".

Applications (e.g., inductive loads) specifying open-delayed transition will require a transfer switch with a "neutral-position".

Switched Neutral

For three-phase power applications requiring that the neutral conductor be switched, transfer switches can be configured with a fully rated fourth pole that performs identical to the individual phase (A, B, C) power poles. For single-phase applications, a fully rated third pole can be configured.

A switched neutral is commonly used when the transfer switch is fed by separately derived power sources. The benefits of using a switched neutral include the following:

- Inhibits circulating ground current from flowing between power sources on the neutral conductor that can cause nuisance tripping of the ground fault relay at the de-energized or unconnected source
- Prevents de-sensitizing the ground fault relay at the energized or connected source
- Eliminates the need for complex ground fault sense wiring

Note: For more detail, reference Eaton White Paper IA08700002E.

For closed transition transfer switches, the switched neutral pole operates as “make-before-break” and simultaneous closure or overlapping of the neutral contacts is limited to 100 ms.

For open transition transfer switches, the switched neutral pole operates in a “break-before-make” fashion and eliminates potential problems that can occur with a three-pole solid neutral or three-pole overlapping neutral (not offered by Eaton) configuration.

The likelihood of a ground fault occurring during the time period that neutral contacts are simultaneously closed or overlapped is just as likely as any other time but perhaps slightly more. When transferring between power sources, dynamic changes are introduced into the system such as moving contacts, vibration and energizing previously de-energized conductors that may push and pull equipment and cables in different directions.

Configuration	Advantages	Disadvantages
Three-pole	Lower cost	Nuisance tripping of ground fault (GF) relay on de-energized or unconnected source. De-sensitizing the ground fault relay at the energized or connected source. Added complexity to implement ground fault relay circuit to prevent nuisance tripping of ground fault relay at de-energized or unconnected source.
Four-pole (switched neutral)	No circulating ground current (eliminates nuisance tripping of ground fault relay at de-energized or unconnected source and desensitizing ground fault relay at energized or connected source).	Higher cost
Three-pole (overlapping neutral)	May be less expensive than four-pole if overlapping neutral is not fully rated.	During the time when both neutrals are connected, the same disadvantages as a three-pole switch exists.

Bypass Isolation Automatic Transfer Switches

For simplified maintenance and improved uptime, bypass isolation automatic transfer switches provide dual switching functionality and redundancy for critical applications. The primary switching mechanism (automatic transfer switch) handles the day-to-day distribution of electrical power to the load, while the secondary switching mechanism (bypass switch) serves as a backup or redundant device. During repair or maintenance procedures, service personnel can bypass power around the automatic transfer switch through the bypass to ensure that critical loads remain powered without interruption.

In some bypass isolation transfer switch designs, the bypass switch is fully automatic and self-acting, providing increased redundancy. When in the automatic bypass mode of operation, the control logic continues to monitor the normal power source and will automatically initiate a transfer to the alternate source should the normal source fail.

A bypass isolation transfer switch is frequently selected for use in healthcare, as well as in other critical applications, because it allows the automatic transfer switch (ATS), and in some cases the bypass switch, to be drawn out and isolated from the power source(s) to facilitate regular maintenance, inspection and testing as prescribed by code (NFPA 110).

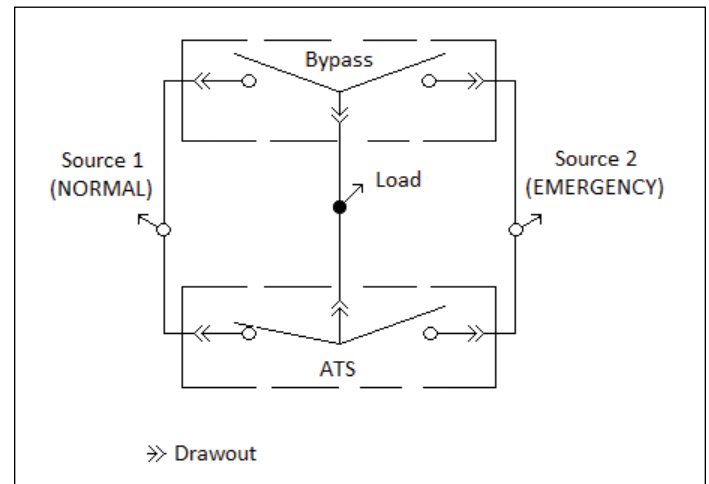


Figure 25.1-12. Bypass Isolation ATS Schematic Drawing

Service Entrance Transfer Switches

Facilities with a single utility connection and a single emergency power source will often have an automatic transfer switch located at the service entrance to ensure that critical loads can quickly and safely shift to emergency power (generator) if utility power is interrupted. Non-critical loads are often inhibited or shed from connection to the emergency power source to avoid capacity overload.

Service entrance rated transfer switches include integral overcurrent protection and a disconnect means allowing them to be installed directly at the point of service entrance, which eliminates the need for separate upstream device(s), including additional power connections. As required, they can also include ground fault protection.

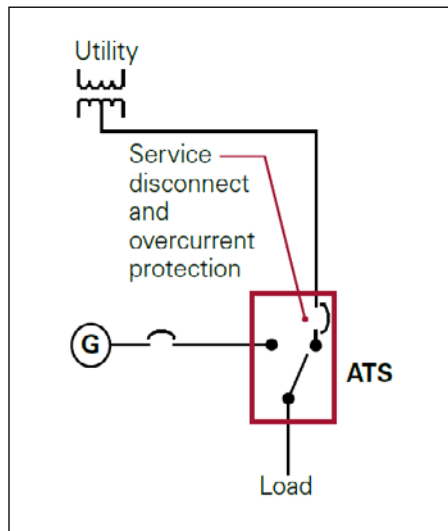


Figure 25.1-13. Service Entrance Transfer Switch with Integral Overcurrent Protection Saves Space and Cost

Arc Flash Reduction

When required by the National Electrical Code (NEC), integral overcurrent protection can be configured with technology to reduce clearing time, such as an Arcflash Reduction Maintenance System (ARMS), resulting in lower incident energy at all downstream work locations.

A circuit breaker equipped with ARMS can improve worker safety by providing a simple and reliable method to reduce fault clearing time. For applications where the highest continuous current trip setting of the overcurrent device in a circuit breaker is rated (or can be adjusted to) 1200 A or higher, a method to reduce clearing time is required per NEC 240.87.

When the ARMS maintenance mode is enabled, an integral analog trip circuit provides an accelerated instantaneous trip. To facilitate maximum arc flash reduction while avoiding nuisance tripping, the ARMS pickup level is adjustable.

Service entrance transfer switch construction can vary in the marketplace and care should be taken by the consulting engineer to consider when the transfer equipment needs to be “fully UL 1008 Listed” and marked for use at 100% of rated current.

The phrase “fully UL 1008 listed” is used to describe the entire transfer switch enclosure assembly—including the integral circuit breaker and power bus—which has passed rigorous temperature rise performance testing required by the UL 1008 standard for transfer switch equipment.

Table 25.1-8. Incident Energy Level Decreases with ARMS

Service Entrance Transfer Switch Rating (A)	Available Fault Current (kA)	Arcing Fault Current (kA)	Without ARMS		With ARMS	
			Maximum Clearing Time (sec)	Incident Energy (cal/cm ²)	Maximum Clearing Time (sec)	Incident Energy (cal/cm ²)
4000	64	32	0.5	58.4	0.04	4.7
3000	51	26.4	0.5	47.3	0.04	3.8
2000	39	21	0.5	37	0.04	3.0
1600	28	15.8	0.5	27.2	0.04	2.2
1200	19	11.3	0.5	19	0.04	1.5

Note: Overcurrent protection device modeled is Eaton Magnum DS circuit breaker (520MC or 1150+ trip). When Eaton MCCB (310+ trip) is used as the protection device, maximum clearing time (ARMS) is 0.03 sec. Arcing fault current and incident energy values derived using SKM System Analysis software Incident energy is calculated immediately downstream of transfer switch load.

UL 1008 Standard

The industry safety standard governing the construction and performance criteria for transfer switch equipment, having a maximum voltage rating of 1000V, is UL 1008.

To ensure a minimum level of reliability, the standard requires that all transfer switch equipment, listed to apply the UL 1008 mark, meet rigorous performance testing—regardless of the design type.

Performance Tests

Undervoltage

A voltage sensing relay coil shall be capable of withstanding 95% of rated pull-in voltage without damage.

Overvoltage

An electromagnet coil shall be capable of withstanding 110% of rated voltage without damage.

Overload

The transfer switch must operate for a number of operation cycles, with a non-unity power factor, at a multiple of its rated current.

Dielectric

The transfer switch shall be capable of withstanding 1000 Vac, plus twice its maximum rated voltage, without breakdown.

Temperature Rise

While operating at 100% of its rated current, the transfer switch temperature shall not exceed a maximum value, sustain material damage or pose a fire risk.

Endurance

The transfer switch must operate for thousands of operation cycles without fail.

Withstand and Closing

With the transfer switch closed into a test circuit, it must “withstand” a short-circuit current, at a specific voltage, for a specified time period or until a specific overcurrent protective device opens. The same transfer switch sample must then “close-into” a test circuit, with a short-circuit current applied, for a specified time period or until a specific overcurrent protective device opens. At the conclusion of each test, a set of operational, physical and electrical criteria must be met.

An optional short-time variant of the test can be performed at the request of the manufacturer but is not required to obtain a UL 1008 mark.

Withstand Closing Current Ratings

When applying a transfer switch for use in a power distribution system, consideration must be given to the withstand closing current rating (WCR) to ensure system integrity and reliability.

The UL 1008 standard permits transfer switches to be marked with one or more short-circuit and/or short-time WCRs specific to an overcurrent protection (OCP) device type. Transfer switches with multiple ratings provide greater application flexibility.

The WCR represents a transfer switch's capability to ride-out a fault condition until the overcurrent protective device (a circuit breaker or fuse that is integral to the transfer switch assembly or is located externally upstream) opens and clears the fault. The WCR, applicable up to a maximum voltage, is given in thousands of amperes and must be equal to or greater than the available fault current calculated at the location of the transfer switch in the electrical circuit. In some instances, a WCR may be further qualified by a maximum time duration.

Short-Circuit Withstand Closing Rating

Applied in electrical circuits where the overcurrent protection (OCP) device, a fuse or circuit breaker, is equipped with an instantaneous trip response capable of clearing a fault quickly without intentional delay.

Various transfer switch short-circuit WCR examples are as follows:

- When the overcurrent protection device is an external circuit breaker, of **any** type, a “time-based” short-circuit WCR can be applied. An important caveat is that the maximum clearing time of the circuit breaker's instantaneous trip response must be equal to or less than the maximum time duration of the marked short-circuit WCR.
- When the overcurrent protection device is an external circuit breaker, of a **specific** type that appears on a manufacturer's list, a “specific circuit breaker” short-circuit WCR can be applied and offers a higher current rating compared to a time-based rating.
- When the overcurrent protection device is a fuse, of a **specific** type or classification, a “fuse” short-circuit WCR can be applied and offers the highest current rating.
- When the overcurrent protection (OCP) device is integral to the transfer switch assembly, an “integral OCP” short-circuit WCR can be applied. A typical use is a service entrance transfer switch that is fed directly from the utility.

A transfer switch short-circuit withstand closing current rating (WCR) is frequently utilized in circuits where the overcurrent protective device is a UL 489 circuit breaker. A common example is a molded case circuit breaker installed in UL 891 switchboard, serving as a feeder to a transfer switch.

When applying a transfer switch short-circuit WCR, it's important to note that UL 489 Listed circuit breakers include a magnetic, built-in instantaneous override that can't be defeated or disabled. For molded case breakers, the override is fixed at approximately 10–12 times the nominal trip or frame rating. For insulated case breakers, the override is fixed at approximately 13–18 times the nominal trip or frame rating.

For many years, fuses and thermal-magnetic circuit breakers (UL 489) have successfully been used to provide overcurrent protection for short-circuit rated transfer switches. Today, circuit breakers are more commonly configured with an electronic trip unit having a short-time element (LS, LSI, LSG, LSG), allowing the short-time pick-up/delay to be adjusted.

When a circuit breaker's short-time element adjustments are set to maximum, the protection provided can be similar to that of a fuse or thermal-magnetic circuit breaker. However, adjusting the settings to something less than maximum can provide shorter clearing times and increased protection at lower level faults when compared to a fuse (**Figure 25.1-14**) or a thermal-magnetic circuit breaker. As a result, UL 489 breakers equipped with a short-time element have the ability to provide “better protection” compared to a fuse or a circuit breaker without a short-time element.

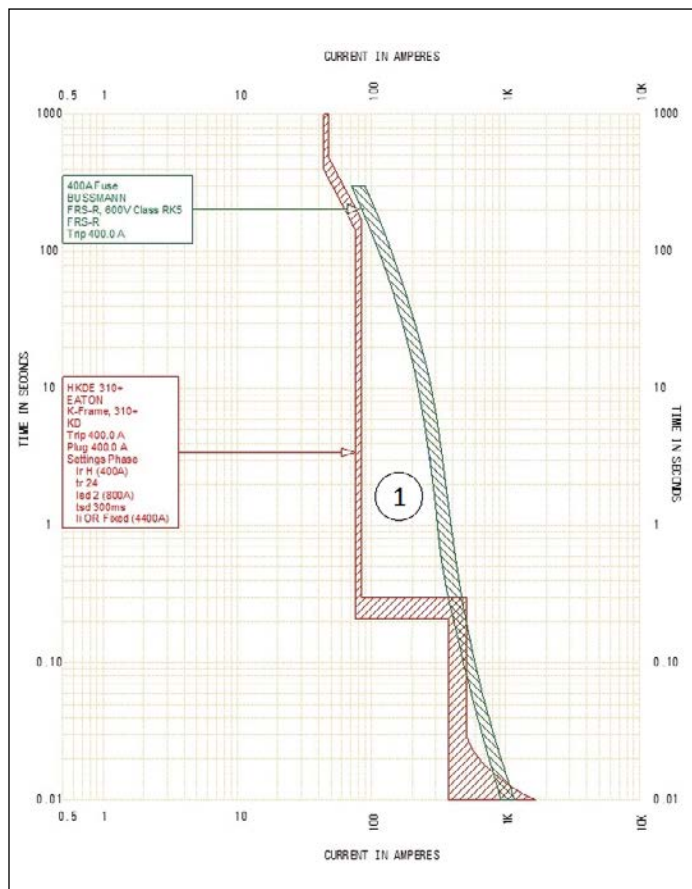


Figure 25.1-14. Time-current characteristic curve showing that a UL 489 circuit breaker with LSI trip (red curve) can clear the same level of fault current more quickly (region 1) than a fuse (green curve)

Short-Time Withstand Closing Rating

Typically applied in critical electrical circuits where the overcurrent protection device is a circuit breaker, equipped with an adjustable electronic trip capable of providing intentional delay, that allows for selective coordination within the distribution system. In many cases, the instantaneous response of the circuit breaker is disabled.

When a transfer switch carries an optional short-time WCR, it will always be qualified by a maximum time duration. Values typically range between 0.1 and 0.5 seconds correlating with a circuit breaker's short-time response. To ensure proper protection, the circuit breaker short-time settings must be coordinated with the maximum time duration of the marked short-time WCR.

Short-time WCRs are frequently utilized in circuits where the overcurrent protective device is a UL 1066 circuit breaker, such as UL 1558 switchgear.

Transfer switches with a short-time WCR and maximum time duration of 0.5 seconds offer the greatest flexibility to the specifying engineer when designing a selectively coordinated system.

Life Expectancy

Transfer switches are periodically exercised upon a loss of normal power or when conducting routine testing. Many designs include control logic with a plant exerciser capable of initiating a test automatically based on a programmed schedule (weekly, biweekly, monthly).

Assuming a transfer switch is exercised once a week through scheduled testing or a power outage condition, an approximation of life expectancy can be made based on UL 1008 endurance test criteria that is conducted with and without rated current.

Table 25.1-9. UL 1008 Endurance Testing

Transfer Switch Rating (Amperes)	Number of Operation Cycles		Total
	With Current	Without Current	
0–300	6000	—	6000
301–400	4000	—	4000
401–800	2000	1000	3000
801–1600	1500	1500	3000
1601 and above	1000	2000	3000

Table 25.1-10. Estimated Transfer Switch Life Expectancy

Transfer Switch Rating (Amperes)	52 Transfer/Retransfer Operations per Year		
	With Current (Years)	Without Current (Years)	Total (Years)
0–300	115	—	115
301–400	76	—	76
401–800	38	19	57
801–1600	28.5	28.5	57
1601 and above	19	38	57

NFPA 70 System Installation Types

Transfer switches are employed in a variety of special conditions that typically fall into one of four categories defined by the National Electrical Code (NFPA 70): emergency systems, legally required systems, critical operations power systems and optional standby systems.

Emergency systems

Emergency systems supply, automatically distribute and control electricity used by systems essential to life safety during fires and other disasters. They include fire detectors, alarms, emergency lights, elevators, fire pumps, public safety communication systems and ventilation systems, and are commonly found in hotels, theaters, sports arenas and hospitals.

Emergency systems are regulated by a municipal, state, federal or other government agency. Transfer from the normal power source to the emergency source must complete within 10 seconds and meet the requirements of Article 700 of the National Electrical Code (NFPA 70). In addition, overcurrent devices must be selectively coordinated with all supply-side overcurrent protective devices.

Legally Required Systems

Legally required systems automatically supply power to a selected set of regulated loads not classified as emergency systems when normal power is unavailable. They serve critical heating, refrigeration, communication, ventilation, smoke removal, sewage disposal and lighting functions that could create hazards or hamper rescue or fire-fighting operations if denied electrical power.

As with emergency systems, legally required systems are regulated by municipal, state, federal and other governmental agencies. Transfer from the normal power source to the emergency source must complete within 60 seconds and meet the requirements of Article 701 of the National Electrical Code (NFPA 70). Overcurrent devices must be selectively coordinated with all supply-side overcurrent protective devices.

Critical Operations Power Systems (COPS)

COPS supply, distribute and control electricity in designated critical areas when a normal power source fails. They include HVAC, fire alarm, security, communication, signaling and other services in facilities that a government agency has deemed important to national security, the economy or public health and safety.

All COPS must meet the requirements of Article 708 of the National Electrical Code (NFPA 70), and their overcurrent devices must be selectively coordinated with all supply-side overcurrent protective devices.

Optional Standby Systems

Optional standby systems supply power to loads with no direct bearing on health or life safety and are not required to function automatically during power failures. They are typically found in commercial buildings, farms and even residences, and must meet the requirements of Article 702 of the National Electrical Code (NFPA 70).

Special Occupancies

In addition to the special conditions previously discussed, transfer switches are utilized in the critical, life safety and equipment branches of an essential electrical system located within a healthcare facility and subject to Article 517 of the National Electrical Code (NFPA 70).

Other Standards

Other relevant industry standards for transfer switches are NFPA 99 (Health Care Facilities Code) and NFPA 110 (Emergency and Standby Power Systems).

Eaton
1000 Eaton Boulevard
Cleveland, OH 44122
United States
Eaton.com

© 2024 Eaton
All Rights Reserved
Printed in USA
Publication No. DG140001EN / Z29701
November 2024