


Correct connection


2-pole

30, 300mA Types:

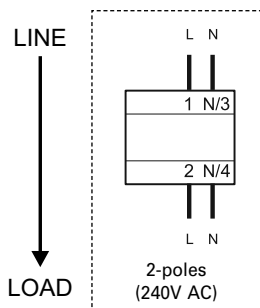


4-pole

30mA -400 Types:

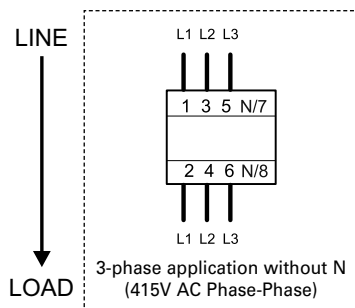


4-pole

30mA Types:

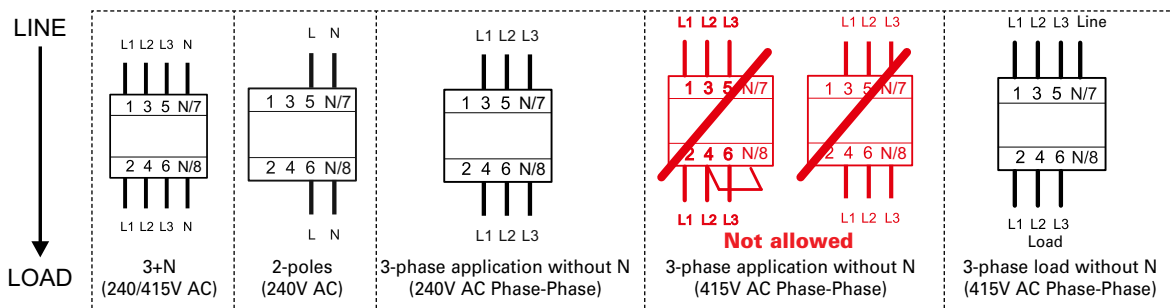

300mA Types:

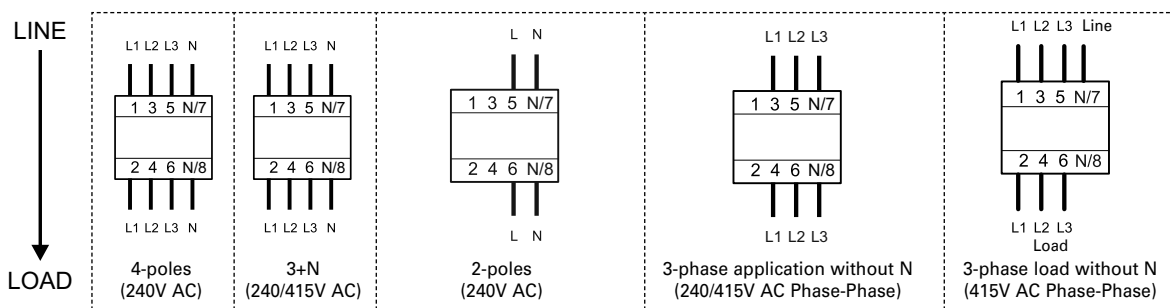

- Disconnect load side of the switch gear, if you make a insulation test of the installation!
- Please take care of supply side and load side!