





**Power
Defense™**

**Circuit Breaker
Accessory**

**For PDG3
Frame**

**PDG3 - Screw Terminal/End Cap 400 amps, 3 Poles
Cat. No. PDG3X3TS400
Quantity - 1**

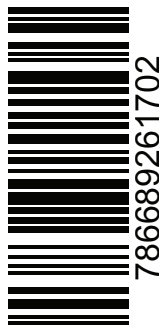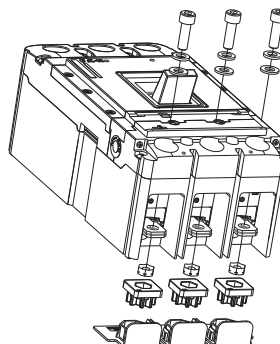

**INSTALL END CAP PRIOR TO BREAKER INSTALLATION.
Instructions For Assembly:**

- Place End Cap on Breaker.
- Install Breaker.
- Fasten Conductors (Install Bolted Connections).
- Torque Terminal Screws to 120-144 in-lb (14-16 N·m).

IL012262EN H02





**Power
Defense™**

**Circuit Breaker
Accessory**

**For PDG3
Frame**

**PDG3 - Screw Terminal/End Cap 400 amps, 3 Poles
Cat. No. PDG3X3TS400
Quantity - 1**

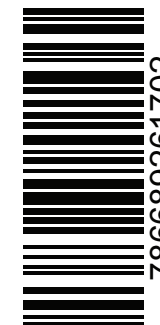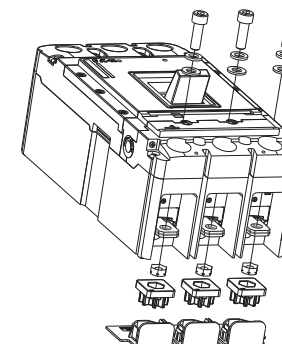

**INSTALL END CAP PRIOR TO BREAKER INSTALLATION.
Instructions For Assembly:**

- Place End Cap on Breaker.
- Install Breaker.
- Fasten Conductors (Install Bolted Connections).
- Torque Terminal Screws to 120-144 in-lb (14-16 N·m).

IL012262EN H02

+





**Power
Defense™**

**Circuit Breaker
Accessory**

**For PDG2
Frame**

**PDG3 - Screw Terminal/End Cap 400 amps, 3 Poles
Cat. No. PDG3X3TS400
Quantity - 1**

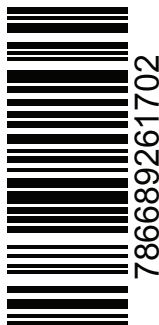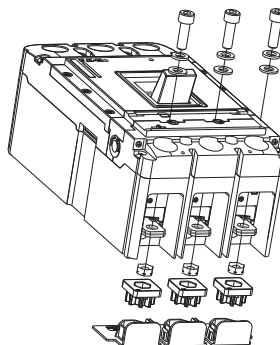

**INSTALL END CAP PRIOR TO BREAKER INSTALLATION.
Instructions For Assembly:**

- Place End Cap on Breaker.
- Install Breaker.
- Fasten Conductors (Install Bolted Connections).
- Torque Terminal Screws to 120-144 in-lb (14-16 N·m).

IL012262EN H02




**Power
Defense™**

**Circuit Breaker
Accessory**

**For PDG3
Frame**

**PDG3 - Screw Terminal/End Cap 400 amps, 3 Poles
Cat. No. PDG3X3TS400
Quantity - 1**

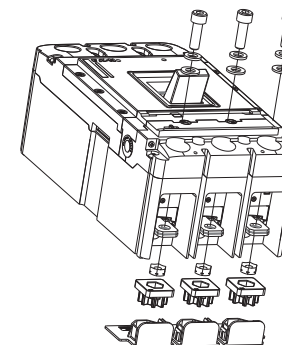

**INSTALL END CAP PRIOR TO BREAKER INSTALLATION.
Instructions For Assembly:**

- Place End Cap on Breaker.
- Install Breaker.
- Fasten Conductors (Install Bolted Connections).
- Torque Terminal Screws to 120-144 in-lb (14-16 N·m).

IL012262EN H02