



# Seismic qualified

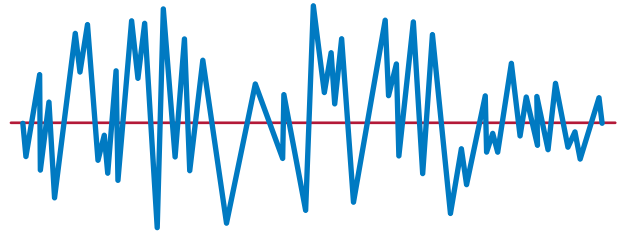

Eaton's equipment identified below was tested for both seismic withstand capability and in accordance with the combined requirements specified in the International Building Code, the California Building Code, and the Uniform Building Code.

As required by the codes, the equipment demonstrated its ability to function after the seismic tests. The seismic capability of the equipment exceeds the worst-case required levels, as illustrated in the figure below.

## Low Voltage Transfer Switches – Floor-Mounted (Magnum DS<sup>®</sup> Breakers and Contactor Type)

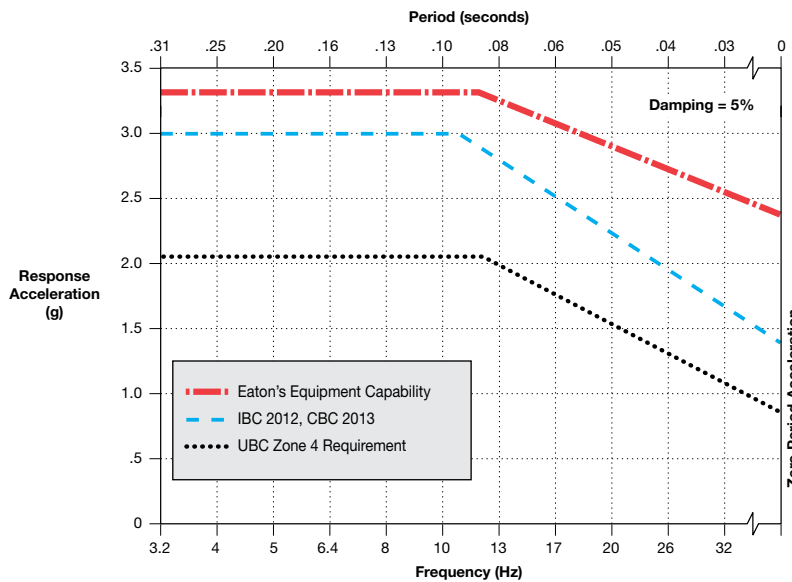

The frequency sweep tests revealed that the lowest equipment natural frequency is:

**5.0 Hz**

Drawing Number  
SA00900011E

*WV Joerg*

William V. Joerger, S.E.  
ISAT

3RD PARTY TEST ENGINEER IN CHARGE

For interpretation of testing data,  
refer to Eaton  
Publication SA12501SE

TESTED BY  
Wyle Laboratories  
January, 2013–70461R12