



Seismic qualified

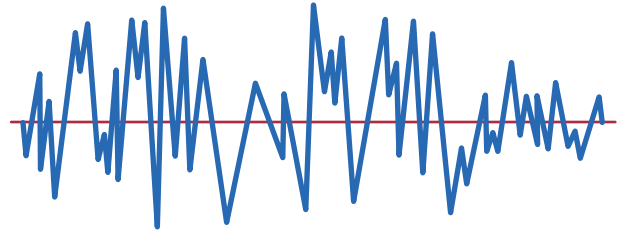

Eaton's equipment identified below was tested for seismic withstand capability in accordance with the combined requirements specified in the International Building Code (IBC) and the California Building Code (CBC).

As required by the codes, the equipment demonstrated its ability to function after the seismic tests. The seismic capability of the equipment is illustrated in the figure below.

Pow-R-Way III® Low-Voltage Busway

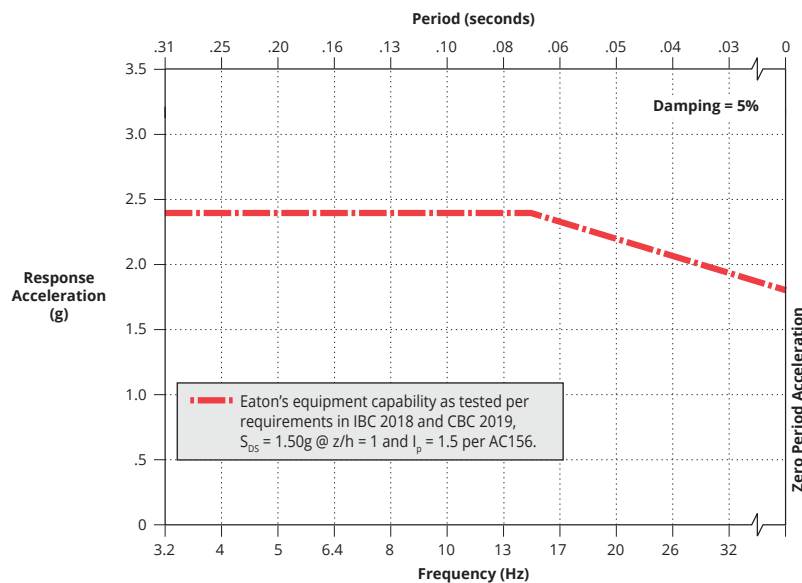

The frequency sweep tests revealed that the lowest equipment natural frequency is:

3.42 Hz*

William V. Joerger, S.E.

3RD PARTY TEST ENGINEER IN CHARGE

For interpretation of testing data, refer to Eaton Publication SA12501SE.

TESTED BY
Dynamic Certification Laboratories
41352-1701a

PEER Lab
463-2654