



# Seismic qualified

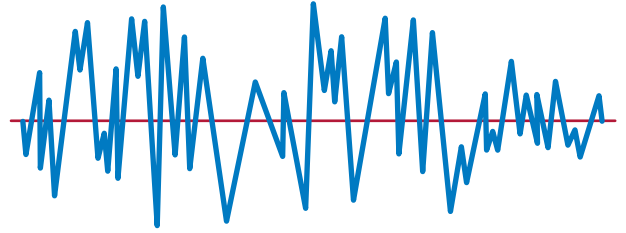

Eaton's equipment identified below was tested for seismic withstand capability and tested in accordance with the combined requirements specified in the International Building Code, the California Building Code, and the Uniform Building Code.

As required by the codes, the equipment demonstrated its ability to function after the seismic tests. The seismic capability of the equipment exceeds the worst-case required levels, as illustrated in the figure below.

## Pow-R-Line® PRL1a, PRL1X, PRL1aF, PRL1a-LX, PRL2a, PRL2X, PRL2aF, PRL2a-LX, PRL3a, PRL3X, PRL3E, PRL4, PRL4X, PRL5P, and F16 Panelboards

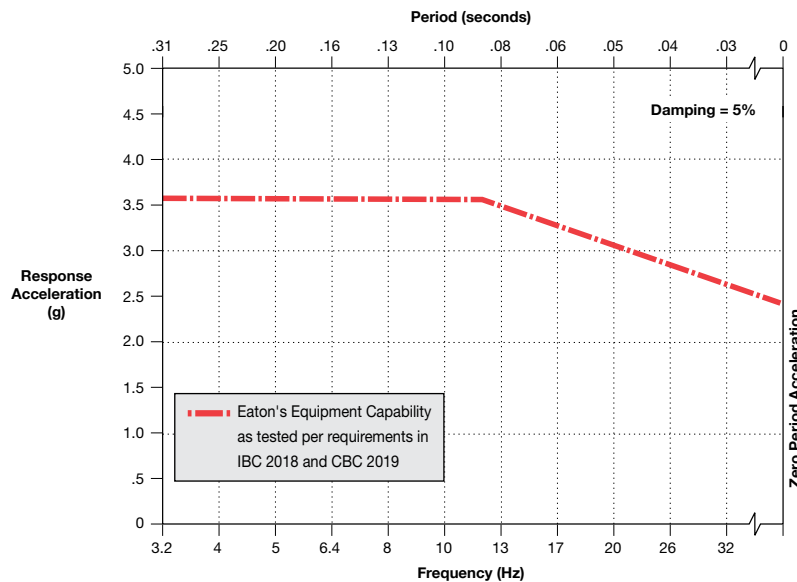

The frequency sweep tests revealed that the lowest equipment natural frequency is:

**N/A  
(Wall-Mounted)**

William V. Joerger, S.E.  
ISAT

3RD PARTY TEST ENGINEER IN CHARGE

**TESTED BY**  
Wyle Laboratories  
April, 2013–70566R12  
August 2019–PR102491  
March 2020–PR113244

For interpretation of testing data,  
refer to Eaton  
Publication SA12501SE